



expert**meter**<sup>TM</sup>  
High Performance Analyzer  
**PM180**

**IEC60870-5-101/104 Communications Protocol**

---

**Reference Guide**

Every effort has been made to ensure that the material herein is complete and accurate. However, the manufacturer is not responsible for any mistakes in printing or faulty instructions contained in this book. Notification of any errors or misprints will be received with appreciation.

For further information regarding a particular installation, operation or maintenance of equipment, contact the manufacturer or your local representative or distributor.

#### REVISION HISTORY

A1	March 2015	Release
----	------------	---------

# Table of Contents

<b>1 General .....</b>	<b>7</b>
<b>2 Protocol Implementation .....</b>	<b>8</b>
<b>2.1 Configuring IEC 60870-5 .....</b>	<b>8</b>
<b>2.2 Communicating via IEC 60870-5 Ports .....</b>	<b>8</b>
<b>2.3 Device Addressing .....</b>	<b>8</b>
<b>2.4 Information Object Addressing and Mapping .....</b>	<b>9</b>
<b>2.5 Interrogation .....</b>	<b>9</b>
<b>2.6 Cyclic Data Transmission .....</b>	<b>9</b>
<b>2.7 Transmission of Integrated Totals .....</b>	<b>10</b>
2.7.1 Transmission Counters with Local Freeze.....	10
2.7.2 Counter Interrogation with/without Remote Freeze .....	10
<b>2.8 Event Reporting .....</b>	<b>11</b>
<b>2.9 Clock Synchronization.....</b>	<b>12</b>
<b>2.10 Single and Double Commands .....</b>	<b>12</b>
<b>2.11 Read Command .....</b>	<b>13</b>
<b>2.12 Parameter Loading .....</b>	<b>13</b>
<b>2.13 Data Types .....</b>	<b>13</b>
2.13.1 Single Point Information .....	13
2.13.2 Double Point Information .....	13
2.13.3 Normalized Values.....	14
2.13.4 Scaled Values.....	14
2.13.5 Floating Point Numbers.....	15
2.13.6 Packed Long Integer and Octet String Formats .....	15
<b>2.14 Password Protection.....</b>	<b>15</b>
<b>2.15 Interoperability.....</b>	<b>15</b>
<b>3 Information Object Map .....</b>	<b>16</b>
<b>3.1 Mapped Information Objects.....</b>	<b>16</b>
Mapped Object Points .....	16
<b>3.2 General Information Objects .....</b>	<b>17</b>
3.2.1 Single Point Objects.....	17
Digital Inputs.....	17
Relay Outputs.....	17
Internal Static Events .....	17
Setpoint Status SP1-SP64.....	17
3.2.2 Double Point Objects .....	17
Digital Inputs.....	18
Relay Outputs.....	18
3.2.3 Measured Values .....	18
Special Inputs .....	18
1/2-Cycle Values.....	18
1-Cycle Phase Values .....	19
1-Cycle Low Phase Values.....	20
1/2-Cycle Analog Inputs .....	20
1-Cycle High Phase Values .....	20
1-Second Analog Inputs .....	21
1-Cycle Total Values.....	21
1-Cycle Auxiliary Values .....	21
Fundamental Phasor Values .....	21
1-Second Phase Values.....	22
1-Second Low Phase Values.....	23

1-Second High Phase Values .....	23
1-Second Total Values.....	24
1-Second Auxiliary Values.....	24
Present Harmonic Demands .....	24
Present Demands.....	25
Symmetrical Components .....	26
V1 Harmonics .....	26
V2 Harmonics .....	26
V3 Harmonics .....	26
V4 Harmonics .....	26
I1 Harmonics.....	26
I2 Harmonics.....	27
I3 Harmonics.....	27
I4 Harmonics.....	27
V1 Harmonic Voltages (odd numbers) .....	27
V2 Harmonic Voltages (odd numbers) .....	27
V3 Harmonic Voltages (odd numbers) .....	27
V4 Harmonic Voltages (odd numbers) .....	27
I1 Harmonic Currents (odd numbers).....	28
I2 Harmonic Currents (odd numbers).....	28
I3 Harmonic Currents (odd numbers).....	28
I4 Harmonic Currents (odd numbers).....	28
Total Harmonic kW (odd numbers) .....	28
Total Harmonic kvar (odd numbers).....	28
Total Harmonic Power Factor (odd numbers) .....	28
Flicker .....	28
Minimum 1-Cycle Phase Values .....	29
Minimum 1-Cycle Total Values.....	30
Minimum 1-Cycle Auxiliary Values .....	30
Minimum Analog Inputs .....	30
Programmable Min/Max Minimum Values.....	30
Maximum 1-Cycle Phase Values .....	30
Maximum 1-Cycle Total Values.....	31
Maximum 1-Cycle Auxiliary Values.....	31
Maximum Analog Inputs .....	32
Maximum Demands .....	32
Programmable Min/Max Maximum Values.....	32
Maximum Harmonic Demands .....	33
Maximum Analog Input Demands .....	33
Present Analog Input Demands .....	33
1-Cycle Analog Inputs .....	33
Raw Analog Inputs .....	34
TOU Parameters .....	34
Scaled Analog Outputs .....	34
Billing Summary Accumulated Demands.....	34
Billing Summary Block Demands .....	34
Billing Summary Sliding Window Demands .....	34
Billing Summary Maximum Demands .....	34
Billing TOU Maximum Demand Register #1.....	34
Billing TOU Maximum Demand Register #4.....	35
Billing TOU Maximum Demand Register #2.....	35
Billing TOU Maximum Demand Register #5.....	35
Billing TOU Maximum Demand Register #3.....	35
Billing TOU Maximum Demand Register #6.....	35
Billing TOU Maximum Demand Register #7.....	35
Billing TOU Maximum Demand Register #8.....	35
Billing TOU Maximum Demand Register #9.....	35
Billing TOU Maximum Demand Register #10.....	36
Billing TOU Maximum Demand Register #11 .....	36

Billing TOU Maximum Demand Register #12 .....	36
Billing TOU Maximum Demand Register #13 .....	36
Billing TOU Maximum Demand Register #14 .....	36
Billing TOU Maximum Demand Register #15 .....	36
Billing TOU Maximum Demand Register #16 .....	36
V1/V12 Harmonic Angles .....	37
V2/V23 Harmonic Angles .....	37
V3/V31 Harmonic Angles .....	37
V4 Harmonic Angles .....	37
I1 Harmonic Angles .....	37
I2 Harmonic Angles .....	37
I3 Harmonic Angles .....	37
I4 Harmonic Angles .....	37
0.2-Second RMS and Auxiliary Values .....	38
3-Second RMS and Auxiliary Values .....	38
1-Minute RMS and Auxiliary Values (GOST) .....	39
10-Minute RMS and Auxiliary Values .....	40
2-Hour RMS and Auxiliary Values .....	40
0.2-Second Harmonics .....	41
3-Second Harmonics .....	42
10-Minute Harmonics .....	43
2-Hour Harmonics .....	44
Present PQ Measurements (EN50160) .....	45
Present PQ Measurements (GOST 13109) .....	46
Present PQ Measurements (GOST 54149) .....	47
<b>3.2.4 Integrated Totals .....</b>	<b>48</b>
Counters .....	48
Total Energies .....	48
Billing Summary Registers .....	49
Billing TOU Register #1 .....	49
Billing TOU Register #2 .....	49
Billing TOU Register #3 .....	49
Billing TOU Register #4 .....	49
Billing TOU Register #5 .....	50
Billing TOU Register #6 .....	50
Billing TOU Register #7 .....	50
Billing TOU Register #8 .....	50
Billing TOU Register #9 .....	50
Billing TOU Register #10 .....	50
Billing TOU Register #11 .....	50
Billing TOU Register #12 .....	51
Billing TOU Register #13 .....	51
Billing TOU Register #14 .....	51
Billing TOU Register #15 .....	51
Billing TOU Register #16 .....	51
<b>3.3 Device Status and Control Parameters .....</b>	<b>52</b>
Device Port Identification .....	52
Device Diagnostics .....	52
Reference Meter Time .....	52
Device Reset/Clear Registers .....	52
Device Authorization Register .....	52
<b>3.4 System Parameters .....</b>	<b>54</b>
Device Identification .....	54
Factory Device Settings .....	54
<b>3.5 Device Setup Parameters .....</b>	<b>55</b>
Communication Ports Setup Parameters .....	55
Basic Device Setup Parameters .....	55
Device Options Setup .....	56
Device Data Scales .....	56

<b>3.6 Protocol Setup Parameters.....</b>	<b>57</b>
IEC 60870-5 Options Setup.....	57
IEC 60870-5 Class 2 Data and Counters Setup.....	57
IEC 60870-5 Assignable Point Map and Events Setup.....	58
<b>4 Data Scales and Units .....</b>	<b>59</b>
Data Scales .....	59
Data Units .....	59
<b>5 Data Formats.....</b>	<b>60</b>
Wiring Mode .....	60
Device Diagnostics .....	60
Single Point Info Static Type .....	60
Single Point Info Event Type .....	60
Double Point Info Static Type .....	60
Double Point Info Event Type .....	60
Measured Value Static Type .....	60
Measured Value Event Type .....	60
Integrated Totals Static Type .....	61
Integrated Totals Event Type .....	61
<b>6 Configuring IEC 60870-5.....</b>	<b>62</b>
<b>6.1 Configuring IEC 60870-5 Options.....</b>	<b>62</b>
<b>6.2 Remapping Point Addresses and Event Reporting .....</b>	<b>66</b>
<b>6.3 Configuring Class 2 Data and Counter Transmission .....</b>	<b>67</b>
<b>Appendix A IEC 60870-5 Interoperability Profile.....</b>	<b>70</b>
<b>A.1 IEC 60870-5-101 Protocol Implementation Conformance Statement (PICS) .....</b>	<b>70</b>
A.1.1 System or device .....	70
A.1.2 Network configuration.....	70
A.1.3 Physical layer .....	70
A.1.4 Link layer .....	71
A.1.5 Application layer.....	72
A.1.6 Basic application functions .....	76
<b>A.2 IEC 60870-5-104 Protocol Implementation Conformance Statement (PICS) .....</b>	<b>79</b>
A.2.1 System or device .....	79
A.2.2 Network configuration.....	79
A.2.3 Physical layer .....	79
A.2.4 Link layer .....	80
A.2.5 Application layer.....	81
A.2.6 Basic application functions .....	85

# 1 General

This document specifies a subset of the IEC60780-5-101/104 communications protocol used to transfer data between a master controlling station and the PM180. The document provides the complete information necessary to develop third-party communications software capable of communication with PM180 meters.

IEC 60870-5-101/104 references:

- IEC 60870-5-1:1990, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 1: Transmission frame formats
- IEC 60870-5-2:1991, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 2: Link transmission procedures
- IEC 60870-5-3:1992, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 3: General structure of application data
- IEC 60870-5-4:1993, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 4: Definition and coding of application information elements
- IEC 60870-5-5:1995, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 5: Basic application functions.
- IEC 60870-5-101:2003-02, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 101: Companion standard for basic telecontrol tasks
- IEC 60870-5-104:2006-06, Telecontrol Equipment and Systems - Part 5, Transmission Protocols - Section 104: Network access for IEC 60870-5-101 using standard transport profiles

## **2 Protocol Implementation**

### **2.1 Configuring IEC 60870-5**

The PM180 protocol stack is implemented in a very flexible manner. Most of IEC 60870-5-101/104 protocol features are user-configurable allowing easy adaptation for use in different IEC 60870-5 installations. To keep maximum interoperability with master RTU and SCADA systems, the PM180 supports all standard ASDU types for data interrogation, event reporting and control.

The support PAS configuration software supplied with the meter provides all necessary tools for remote configuration of the meter via serial ports or via a TCP/IP Internet connection using either IEC 60870-5-101/104, or Modbus protocol.

See Chapter 6 for instructions on how to configure IEC 60870-5 options in the meter for your particular installation.

See the PM180 Installation and Operation Manual for more information on configuring the meter via PAS.

The protocol implementation details are explained in the following sections.

### **2.2 Communicating via IEC 60870-5 Ports**

The PM180 supports unbalanced IEC 60870-5-101 communications via serial ports and multiple balanced IEC 60870-5-104 TCP/IP connections via an Ethernet port.

#### **Serial IEC 60870-5-101 Connections**

The PM180 has one RS-232/422/485 port, additional RS-485/485 and RS-485 ports can be ordered to provide communications with master stations. Listed serial ports can operate in IEC 60870-5-101 mode.

#### **TCP/IP IEC 60870-5-104 Connections**

The Ethernet port provides an IEC 60870-5-104 TCP server on port 2404 that supports some simultaneous connections with controlling stations via IEC 60870-5-104 protocol.

Modbus TCP server on port 502 and / or DNP TCP server on port 20000 provide additional simultaneous connections to the meter without affecting to the IEC 60870-5-104 communication. Thus, you can easily configure and monitor network meters using PAS, using advanced Modbus features.

NOTES:

Cyclic / spontaneous transmission of data through the port IEC 60870-5-104 require appropriate configuration of the device (see Section 6 for details).

The following functionality is specific for the PM180 IEC 60870-5-104 port:

1. An idling connection is closed in 2 minutes if there is no activity on both sides. To keep a rarely used connection open, either periodically send test APDU to the meter, or configure cyclic data transmission in the meter to maintain some kind of activity on the connection socket.
2. Data transmission is suspended when the number of unacknowledged ASDU sent to a controlling station exceeds the maximum number configured in the meter. So the master station should send acknowledgments as frequently as possible to avoid loss of data.

You can disable this feature by setting the maximum number of unacknowledged ASDU to zero causing the meter to never suspend data transmission.

### **2.3 Device Addressing**

The data link address field in IEC 60870-5-101 and the COMMON ADDRESS OF ASDU represent the device address assigned in the meter to an IEC 60870-5-101/104

communication port. See the PM180 Installation and Operation Manual on how to configure the device address in your meter.

The data link address and COMMON ADDRESS OF ASDU length are configurable for IEC 60870-5-101 ports (see Section 6.1 for details).

## 2.4 Information Object Addressing and Mapping

Information object address length is configurable for IEC 60870-5-101 ports and is fixed to 3 octets in IEC 60870-5-104. See Section 6.1 for more information on selecting the object address length in the meter.

Information object addressing scheme normally uses structured two-octet (three-octet in IEC 60870-5-104) addresses. See Chapter 3 for the full list of the available object points and their addresses.

The PM180 allocates a special configurable address space in the range of 1 to 4095 for user-assignable point addresses called mapped points. Mapped points can be used as aliases of the original point addresses to provide a more convenient and faster way for polling and interrogating data. Event reporting in the PM180 is only available for mapped points.

You can remap any of 64 general object points listed in Section 3.2 to a single range or a number of ranges in the configurable address space. See Section 6.2 for more information on remapping object addresses.

Different classes of objects - measurement values, single points, double points and integrated totals – can be remapped to separate ranges with a configurable starting object address. See Section 6.1 on how to configure the starting address for mapped object points.

When required, one-octet addresses can be used for IEC 60870-5-101 ports by remapping points to the address range of 1 to 255.

## 2.5 Interrogation

The PM180 supports general and group interrogation commands for binary and analog objects. Address ranges for general and group interrogation are configurable via the IEC 60870-5 Class 2 Data and Counters Setup (see Section 6.3).

Up to 15 groups can be arranged for group interrogation. Any compatible ASDU data type can be separately selected for each range of points regardless of the configured default object type.

Interrogated data are sent in the order they are listed in the Class 2 Data Setup. The meter always responds to interrogation requests with a sequence of information objects ASDU with the SQ bit in the variable structure qualifier set to 0.

## 2.6 Cyclic Data Transmission

Object address ranges for cyclic data transmission are configurable via the IEC 60870-5 Class 2 Data and Counters Setup (see Section 6.3). Any compatible ASDU data type can be separately selected for each range of points regardless of the configured default object type.

Cyclic data is sent in the order they are listed in the Class 2 Data Setup. The meter always transmits cyclic data using a sequence of information objects ASDU with the SQ bit in the variable structure qualifier set to 0.

### IEC 60870-5-101 Cyclic Transmission

In IEC 60870-5-101, the meter responds to class 2 data requests with data configured for cyclic transmission if there are no higher priority messages ready for transmission. An interrogation command interrupts a cyclic transmission sequence, which is automatically restarted after the interrogation command has been responded.

### IEC 60870-5-104 Cyclic Transmission

In IEC 60870-5-104, configured cyclic data is transmitted periodically to the selected controlling station after it confirms start of data transfer. An interrogation command

interrupts cyclic transmission in progress, which is automatically restarted after the interrogation command has been responded.

See Section 6.1 on how to set up a client IP address for cyclic data transmission and the cyclic transmission period.

## 2.7 Transmission of Integrated Totals

The PM180 supports modes A, B, C and D of acquisition of integrated totals – local freeze (with or without reset) with spontaneous transmission, local freeze (with or without reset) with counter interrogation, counter interrogation with/without remote freeze (with or without reset), and counter freeze by an interrogation command with spontaneous transmission of frozen values.

Object address ranges for counter transmission are configurable via the IEC 60870-5 Class 2 Data and Counters Setup (see Section 6.3). Up to 4 groups can be arranged for counter group interrogation. Any compatible ASDU data type can be separately selected for each range of points regardless of the configured default counter object type.

Interrogated data is sent in the order they are listed in the Class 2 Data and Counters Setup. The meter always transmits counters using a sequence of information objects ASDU with the SQ bit in the variable structure qualifier set to 0.

NOTES:

1. The sequence number in the counter qualifier is incremented modulo 32 after each local or remote freeze.
2. The counter overflow is indicated in case the actual counter rolls over to zero since last counter reading. The counter adjustment is indicated when the counter has been preset or cleared outside of the standard sequence controlled by local freeze and remote interrogation commands.
3. When using multiple connections via IEC60870-5 ports, only one client should use counter interrogation commands with FRZ qualifiers 1-3 to maintain consistency of the counter freeze buffers.
4. Do not apply interrogation commands with FRZ qualifiers 1-2 to counters with local freeze, as they will disturb frozen counter buffers.

### 2.7.1 Transmission Counters with Local Freeze

Integrated totals configured for mode A or B transmission (those checked for local freeze in the IEC 60870-5 Class 2 Data and Counters Setup, see Section 6.3), are locally frozen at configurable intervals synchronized with the meter clock. If the local freeze period is evenly divisible into an hour, the counter freeze/transmission intervals will be synchronized with the beginning of the hour. See Section 6.1 on how to set up the local freeze period for mode A or B transmission.

If the counter range is checked for freeze with reset, the actual counters are reset to zero after current counter values are frozen in the freeze buffers.

Frozen values signed for spontaneous transmission are transmitted with spontaneous cause of transmission <3> in response to class 1 requests in IEC 60870-5-101 and spontaneously to the selected client IP address in IEC 60870-5-104.

Interrogation commands with FRZ=0 for ranges of counters signed for local freeze return locally frozen counter values.

### 2.7.2 Counter Interrogation with/without Remote Freeze

The PM180 supports general and group counter interrogation commands with FRZ qualifiers 0-3:

- <0> - read (no freeze or reset)
- <1> - counter freeze without reset
- <2> - counter freeze with reset

<3> - counter reset

Interrogation commands with remote freeze qualifiers FRZ=1 and FRZ=2 cause the specified counters' values to be locally frozen to the freeze buffers, optionally followed by the reset of the actual counter values for commands with FRZ=2. Commands with FRZ=1-3 do not cause the counter values to be transmitted.

Interrogation commands with FRZ=0 (no freeze, no reset) are responded either with the frozen counter values if the command was preceded by a remote or local freeze, or with the actual counter values for counters that were not frozen.

For mode D of spontaneous counter transmission with remote freeze, check the required counters for spontaneous transmission without local freeze (see Section 6.3). They will be transmitted with cause of transmission <3> in response to class 1 requests in IEC 60870-5-101 and spontaneously to the client IP address selected for spontaneous data transmission in IEC 60870-5-104.

NOTE:

Integrated totals checked for spontaneous transmission without local freeze that have not been frozen by a remote freeze command will be periodically reported at specified local freeze/transmission intervals with the actual counter values.

## 2.8 Event Reporting

The PM180 provides up to 64 configurable setpoints for reporting events when a measured value exceeds a predefine threshold or changes by a certain percentage, or a binary point status changes. The scan period for events is one power frequency cycle time for binary events, and 200 ms for analog events.

Events can only be reported for mapped static object points in the address range of 1 to 4095. Default data types for event reporting are configurable via the IEC 60870-5 Options Setup (see Section 6.1) for supported classes of objects. See Section 6.2 on how to select object point addresses and configure thresholds for event reporting.

The meter always reports events in a chronological order by a sequence of information objects ASDU with the SQ bit in the variable structure qualifier set to 0.

The meter data change buffers can hold up to 128 unreported events.

### IEC 60870-5-101 Event Reporting

In IEC 60870-5-101, collected events are transmitted in response to class 1 requests. The meter can also respond with class 1 data to class 2 requests if there is no class 2 data in transmission and this option is enabled in the IEC 60870-5 Options Setup (see Section 6.1).

### IEC 60870-5-104 Event Reporting

In IEC 60870-5-104, collected events are transmitted spontaneously to the selected controlling station after it confirms start of data transfer. See Section 6.1 on how to set up a client IP address for spontaneous event transmission.

NOTES:

1. Event reports on counter change events always follow the actual counter changes and are reported with the actual counter values.
2. Because the PM180 maintains a single set of data change buffers, only one master connected to the meter can receive spontaneous event reports. You should not send class 1 requests via a serial connection if you configured a client IP address for spontaneous event transmission via a TCP/IP connection.

## 2.9 Clock Synchronization

The meter clock time is local time.

The IV Invalid bit in the binary time elements is set to 1 after the meter loses power and is reset to 0 when the meter time is updated by the C\_CS\_NA\_1 Clock synchronization command.

The meter can periodically request clock synchronization by setting the IV Invalid bit in the time tag of the information objects to 1 if the Time sync period in the IEC 60870-5 Options setup is configured to a non-zero value. See Section 6.1 on how to configure the Time sync period in your meter.

In case of using a tree octet CP24Time2a time tag in event ASDU types, the meter sends spontaneous clock synchronization messages to the controlling station at the beginning of each hour. In IEC 60870-5-104 using CP24Time2a time tags should be avoided.

## 2.10 Single and Double Commands

The PM180 supports single and double commands addressed to meter relay outputs.

See the following table for description of relay output operation using single commands.

Single Command State (SCS)	Qualifier of Command (QU)	Relay Output Operation	
0 (Not permitted)	Any	No action	
1 (OFF)	0 (No additional definitions)	Short pulsed ON	
	1 (Short pulse duration)	Short pulsed ON	
	2 (Long pulse duration)	Long pulsed ON	
	3 (Persistent output)	Latched OFF	
2 (ON)	0 (No additional definitions)	Short pulsed ON	
	1 (Short pulse duration)	Short pulsed ON	
	2 (Long pulse duration)	Long pulsed ON	
	3 (Persistent output)	Latched ON	
3 (Not permitted)	Any	No action	

Double commands must always be sent to the first relay output address between two adjacent addresses occupied by a double point object. See the following table for description of relay output operation using double commands.

Double Command State (DCS)	Qualifier of Command (QU)	Relay Output Operation	
		RO2	RO3
0 (Not permitted)	Any	No action	No action
1 (OFF)	0 (No additional definitions)	Short pulsed ON	No action
	1 (Short pulse duration)	Short pulsed ON	No action
	2 (Long pulse duration)	Long pulsed ON	No action
	3 (Persistent output)	Latched ON	Latched OFF
2 (ON)	0 (No additional definitions)	No action	Short pulsed ON
	1 (Short pulse duration)	No action	Short pulsed ON
	2 (Long pulse duration)	No action	Long pulsed ON
	3 (Persistent output)	Latched OFF	Latched ON
3 (Not permitted)	Any	No action	No action

The short and long pulse duration for pulsed operations are configurable via the IEC 60870-5 Options Setup (see Section 6.1).

NOTE:

Single and double commands with QU=0 are executed using a configured short pulse duration by default.

Command execution is always confirmed by C\_SC\_ACTTERM or C\_DC\_ACTTERM.

Single and double commands with qualifiers QU=0-2 (pulse operation) will not have effect unless meter relay outputs are configured for pulse mode operation, and commands with qualifier QU=3 (persistent output) will not be effective unless relay outputs are configured for operation in either unlatched, or latched mode (both modes provide latched operations on remote commands).

See the meter Installation and Operation manual on how to configure relay outputs for operation in pulse or latched mode. The IEC 60870-5 pulse duration settings override the default relay pulse width configured for relay outputs in the meter.

## 2.11 Read Command

Default data types for responses to a C\_RD\_NA\_1 Read command for general and mapped object points listed in Sections 3.1 and 3.2 are configurable via the IEC 60870-5 Options Setup for supported classes of objects (see Sections 6.1 and 6.2). System and configuration parameters are read in a fixed format indicated for each parameter in Sections 3.3 through 3.6.

The PM180 allows a non-standard interpretation of the Read command variable structure qualifier: a master can request more than one information element starting from the specified information object address by setting the SQ bit to 1 and the number of elements N to a value more than 1.

When a single value is requested, or the object type of the requested values has a time tag, the meter responds to a read request with a sequence of information objects ASDU with the SQ bit in the variable structure qualifier set to 0. If more than one value is requested and the object type does not have a time tag, the meter responds with a sequence of information elements ASDU with the SQ bit set to 1.

## 2.12 Parameter Loading

System and configuration parameters are written with either P\_ME\_NB\_1, or P\_ME\_NC\_1 ASDU type indicated for each parameter in Sections 3.3 through 3.6 with KPA = 32 (private range) in the qualifier of a parameter, and are reported to a Read command with the same object type and attributes.

The PM180 allows a non-standard interpretation of the P\_ME\_NB\_1 and P\_ME\_NC\_1 ASDU variable structure qualifier: a master can write more than one information element starting from the specified information object address by using a sequence of information elements ASDU with the SQ bit set to 1 and the number of elements N more than 1.

## 2.13 Data Types

### 2.13.1 Single Point Information

See the following table for decoding the status of a binary input accessed as a single point object.

Single Point Info Qualifier (SPI)	Digital Input Status
0 (OFF)	OFF (Open)
1 (ON)	ON (Closed)

### 2.13.2 Double Point Information

Double point objects occupy two adjacent object addresses and should always be accessed by addressing the first address of the pair. See the following table for decoding the status of binary inputs accessed as double point objects.

Double Point Info Qualifier (DPI)	Digital Inputs Status	
	DI1	DI2
0 (Intermediate state)	OFF (Open)	OFF (Open)
1 (OFF)	ON (Closed)	OFF (Open)
2 (ON)	OFF (Open)	ON (Closed)
3 (Indeterminate state)	ON (Closed)	ON (Closed)

### 2.13.3 Normalized Values

A normalized value represents per unit scaled reading of a measured value. Normalized values are transmitted as 16-bit signed fixed point numbers (F16, Type 4.1 IEC 60870-5-4) in the range of  $-1..+1 \cdot 2^{-15}$ . On integer platforms, they can be taken as 16-bit signed integer numbers in the range of -32768..+32767 by dividing a value by 32767 to provide same conversion results.

Per unit normalization allows transmission of any measured value within its measurement range being scaled to a 16-bit fixed-point binary number, where  $-1 \cdot 2^{-15}$  corresponds to the minimum negative value measurement and  $1 \cdot 2^{-15}$  corresponds to the maximum value measurement. The actual measurement range and reading resolution are indicated in the object address map for all measured values (see Chapter 3).

To get a true measurement, a normalized value should be converted using the following formula:

$$Y = \text{Raw\_reading} \times \text{Max\_Measurement\_Range}$$

When over-range occurs, a positive value is reported as  $1 \cdot 2^{-15}$  and a negative value as -1 with the OV bit in the quality descriptor byte QDS set to 1.

#### Conversion Example:

If the value you have read at object address 20736, which represents a phase I1 current reading (see Section 3.1), is  $201 \times 2^{-15}$  and the CT primary current setting is 200A, then the current reading in engineering units is as follows:

$$\text{Max\_Measurement\_Range} (\text{see Section 4}) = 2 \times 200\text{A} = 400\text{A}$$

$$\text{Value\_Resolution} = 0.01\text{A}$$

$$\text{True value reading} = (201 \times 2^{-15}) \times 400\text{A} = 2.45\text{A}$$

### 2.13.4 Scaled Values

A scaled value represents the reading of a measured value scaled to a 16-bit integer number. Scaled values are transmitted as 16-bit signed integer numbers (I16, Type 2.1 IEC 60870-5-4) in the range of -32768..+32767.

Integer scaling allows transmission of any measured value within its measurement range being scaled to a 16-bit integer number by dividing by a fixed scale factor.

To get a true measurement, a scaled value should be converted using the following formula:

$$Y = \text{Raw\_reading} \times \text{Scale\_Factor}$$

The scale factor depends on the maximum measurement range and resolution of a measured value as follows:

a) if  $(\text{Max\_Measurement\_Range}/\text{Value\_Resolution}) \leq 32767$  then

$$\text{Scale\_Factor} = 1 \times \text{Value\_Resolution}$$

b) if  $(\text{Max\_Measurement\_Range}/\text{Value\_Resolution}) > 32767$  then

$$\text{Scale\_Factor} = \text{Max\_Measurement\_Range}/32767$$

The actual scale factor and measurement resolution are indicated in the object address map for all measured values (see Chapter 3).

When over-range occurs, a positive value is reported as 32767 and a negative value as -32768 with the OV bit in the quality descriptor byte QDS set to 1.

#### **Conversion Example:**

If the value you have read at object address 20736, which represents a phase I1 current reading (see Section 3.1), is 201 and the CT primary current setting is 200A, then the current reading in engineering units is as follows:

```
Max_Measurement_Range (see Section 4) = 2×200A = 400A  
Value_Resolution = 0.01A  
Max_Measurement_Range/Value_Resolution = 400/0.01 = 40000 > 32767  
True value reading = 201 × (400A/32767) = 2.45A
```

#### **2.13.5 Floating Point Numbers**

A floating point number represents the true readings of a measured value. Floating point numbers are transmitted in an IEEE single precision floating point format (R32.23, Type 5 IEC 60870-5-4).

The actual measurement resolution is indicated in the object address map for all measured values (see Chapter 3).

#### **2.13.6 Packed Long Integer and Octet String Formats**

Some of system and configuration parameters are stored in the meter in 32-bit signed or unsigned integer format or in octet strings that cannot be scaled or represented using floating point numbers. Since IEC-60870-101/104 do not offer compatible ASDU types, the PM180 uses standard scaled value parameter format P\_ME\_NB\_1 for transferring these data types that requires following interpretation in application software.

32-bit integer numbers are packed in two adjacent scaled 16-bit integer numbers in UI32 UNSIGNED INTEGER or I32 SIGNED INTEGER format (Type 1.1 and Type 2.1, IEC 60870-5-4).

Octet strings are packed in continuous 16-bit unsigned integer numbers, two octets in a scaled value, in OCTETSTRING OS8i or OS8iASCII format (Type 7, IEC 60870-5-4).

### **2.14 Password Protection**

System and configuration parameters in the PM180 are password protected from unauthorized changes via communications. Refer to the meter Installation and Operation Manual for details.

A user password must be written to the device authorization register before changing meter parameters. If a correct password is not supplied, the meter will respond to write requests with the cause of transmission "unknown information object address".

### **2.15 Interoperability**

See Appendix A for the device interoperability profile.

## 3 Information Object Map

### 3.1 Mapped Information Objects

IO Address	Point ID	Description	Measurement Range	Units and Resolution	Type	R/W	Notes
1-4095		<b>Mapped Object Points</b>					
1		Mapped point				R/W	
2		Mapped point				R/W	
...		...				R/W	
4095		Mapped point				R/W	

**NOTE:**

Up to 64 general object points can be remapped to addresses 1-4095. See Section 3.2 for the measurement range, resolution and scale factors of the original object points. See Section 6.2 on how to remap object addresses in the meter.

## 3.2 General Information Objects

### 3.2.1 Single Point Objects

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
		<b>Digital Inputs</b>					
17920-18047		Digital inputs DI1-DI128	0x00000000 - 0xFFFFFFFF		UINT32	R	
	0x0600	Digital Input DI1	0/1		M_SP	R	
	0x0601	Digital Input DI2	0/1		M_SP	R	
	...						
	0x067F	Digital Input D128	0/1		M_SP	R	
		<b>Relay Outputs</b>					
18432-18495							
	0x0800	RO1	0/1		M_SP, C_SC	R/W	
	0x0801	RO2	0/1		M_SP, C_SC	R/W	
	...						
	0x083F	RO64	0/1		M_SP, C_SC	R/W	
		<b>Internal Static Events</b>					
18688-18697							
	0x0900	Phase order error	0/1		M_SP	R	
	0x0901	Positive phase order	0/1		M_SP	R	
	0x0902	Negative phase order	0/1		M_SP	R	
	0x0903	0/1	0/1		M_SP	R	
	0x0904	General fault event	0/1		M_SP	R	
	0x0905	Fault detected	0/1		M_SP	R	
	0x0906	External fault trigger	0/1		M_SP	R	
	0x0907	Device fault (non-critical error)	0/1		M_SP	R	
	0x0908	No voltage	0/1		M_SP	R	
	0x0909	Remote control	0/1		M_SP	R	
		<b>Setpoint Status SP1-SP64</b>			M_SP	R	
48128-48191							
	0x7C00	Setpoint SP1	0/1		M_SP	R	
	0x7C01	Setpoint SP2	0/1		M_SP	R	
	...	...					
	0x7C3F	Setpoint SP64	0/1		M_SP	R	

### 3.2.2 Double Point Objects

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
------------	----------	-------------	--------------------------------	-----------------------------------	-------------------	-----	-------

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
64512-64638		<b>Digital Inputs</b>					
+0	0xBC00	Digital Inputs DI1:2	00/01/10/11		M_DP	R	
+1	0xBC01	Digital Inputs DI2:3	00/01/10/11		M_DP	R	
		...					
+126	0xBC7E	Digital Inputs DI127:128	00/01/10/11		M_DP	R	
64640-64702		<b>Relay Outputs</b>					
+0	0xBC80	RO1:2	00/01/10/11		M_DP, C_DC	R/W	
+1	0xBC81	RO2:3	00/01/10/11		M_DP, C_DC	R/W	
		...					
+62	0xBCBE	RO63:64	00/01/10/11		M_DP, C_DC	R/W	

NOTE:

Double point objects occupy two adjacent object addresses and should always be accessed by addressing the first address of the pair.

### 3.2.3 Measured Values

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
16384	0x0000	<b>None</b>	0		M_ME	R	Zero object reference
16640-16641		<b>Special Inputs</b>					
	0x0100	Voltage disturbance	0-100	%	M_ME	R	
	0x0101	Phase rotation order	0=error, 1=positive (ABC), 2=negative (CBA)		M_ME	R	
19328-19350		<b>1/2-Cycle Values</b>					
+0	0xB80	V1 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+1	0xB81	V2 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+2	0xB82	V3 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+3	0xB83	V4 voltage	0-V4max	U4	M_ME	R	
+4	0xB84	V12 voltage	0-Vmax	U1	M_ME	R	
+5	0xB85	V23 voltage	0-Vmax	U1	M_ME	R	
+6	0xB86	V31 voltage	0-Vmax	U1	M_ME	R	
+7	0xB87	I1 current	0-Imax	U2	M_ME	R	
+8	0xB88	I2 current	0-Imax	U2	M_ME	R	
+9	0xB89	I3 current	0-Imax	U2	M_ME	R	
+10	0xB8A	I4 current	0-I4max	U2	M_ME	R	
+11	0xB8B	In current	0-Imax	U2	M_ME	R	
+12	0xB8C	I1x current	0-Ixmax	U2	M_ME	R	
+13	0xB8D	I2x current	0-Ixmax	U2	M_ME	R	
+14	0xB8E	I3x current	0-Ixmax	U2	M_ME	R	
+15	0xB8F	I4x current	0-I4xmax	U2	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+16	0x0B90	Inx current	0-Ixmax	U2	M_ME	R	
+17	0x0B91	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+18	0x0B92	Zero-sequence current	0-Imax	U2	M_ME	R	
+19	0x0B93	Ix Zero-sequence current	0-Ixmax	U2	M_ME	R	
+20	0x0B94	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+21	0x0B95	Current unbalance	0-3000	×0.1%	M_ME	R	
+22	0x0B96	Ix current unbalance	0-3000	×0.1%	M_ME	R	
19456-19491		<b>1-Cycle Phase Values</b>					
+0	0x0C00	V1 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+1	0x0C01	V2 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+2	0x0C02	V3 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+3	0x0C03	I1 current	0-Imax	U2	M_ME	R	
+4	0x0C04	I2 current	0-Imax	U2	M_ME	R	
+5	0x0C05	I3 current	0-Imax	U2	M_ME	R	
+6	0x0C06	kW L1	-Pmax-Pmax	U3	M_ME	R	
+7	0x0C07	kW L2	-Pmax-Pmax	U3	M_ME	R	
+8	0x0C08	kW L3	-Pmax-Pmax	U3	M_ME	R	
+9	0x0C09	kvar L1	-Pmax-Pmax	U3	M_ME	R	
+10	0x0C0A	kvar L2	-Pmax-Pmax	U3	M_ME	R	
+11	0x0C0B	kvar L3	-Pmax-Pmax	U3	M_ME	R	
+12	0x0C0C	KVA L1	0-Pmax	U3	M_ME	R	
+13	0x0C0D	KVA L2	0-Pmax	U3	M_ME	R	
+14	0x0C0E	KVA L3	0-Pmax	U3	M_ME	R	
+15	0x0C0F	Power factor L1	-1000-1000	×0.001	M_ME	R	
+16	0x0C10	Power factor L2	-1000-1000	×0.001	M_ME	R	
+17	0x0C11	Power factor L3	-1000-1000	×0.001	M_ME	R	
+18	0x0C12	V1 voltage THD	0-9999	×0.1%	M_ME	R	<sup>1</sup> 2-cycle value
+19	0x0C13	V2 voltage THD	0-9999	×0.1%	M_ME	R	<sup>1</sup> 2-cycle value
+20	0x0C14	V3 voltage THD	0-9999	×0.1%	M_ME	R	<sup>1</sup> 2-cycle value
+21	0x0C15	I1 current THD	0-9999	×0.1%	M_ME	R	2-cycle value
+22	0x0C16	I2 current THD	0-9999	×0.1%	M_ME	R	2-cycle value
+23	0x0C17	I3 current THD	0-9999	×0.1%	M_ME	R	2-cycle value
+24	0x0C18	I1 K-Factor	10-9999	×0.1	M_ME	R	2-cycle value
+25	0x0C19	I2 K-Factor	10-9999	×0.1	M_ME	R	2-cycle value
+26	0x0C1A	I3 K-Factor	10-9999	×0.1	M_ME	R	2-cycle value
+27	0x0C1B	I1 current TDD	0-1000	×0.1%	M_ME	R	2-cycle value
+28	0x0C1C	I2 current TDD	0-1000	×0.1%	M_ME	R	2-cycle value
+29	0x0C1D	I3 current TDD	0-1000	×0.1%	M_ME	R	2-cycle value
+30	0x0C1E	V12 voltage	0-Vmax	U1	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+31	0x0C1F	V23 voltage	0-Vmax	U1	M_ME	R	
+32	0x0C20	V31 voltage	0-Vmax	U1	M_ME	R	
+33	0x0C21	I1x current	0-Ixmax	U2	M_ME	R	
+34	0x0C22	I2x current	0-Ixmax	U2	M_ME	R	
+35	0x0C23	I3x current	0-Ixmax	U2	M_ME	R	
19712-19725	<b>1-Cycle Low Phase Values</b>						
+0	0xD00	Low L-N voltage	0-Vmax	U1	M_ME	R	
+1	0xD01	Low current	0-Imax	U2	M_ME	R	
+2	0xD02	Low kW	-Pmax-Pmax	U3	M_ME	R	
+3	0xD03	Low kvar	-Pmax-Pmax	U3	M_ME	R	
+4	0xD04	Low kVA	0-Pmax	U3	M_ME	R	
+5	0xD05	Low PF Lag	0-1000	×0.001	M_ME	R	
+6	0xD06	Low PF Lead	0-1000	×0.001	M_ME	R	
+7	0xD07	Low voltage THD	0-9999	×0.1%	M_ME	R	
+8	0xD08	Low current THD	0-9999	×0.1%	M_ME	R	
+9	0xD09	Low K-Factor	10-9999	×0.1	M_ME	R	
+10	0xD0A	Low current TDD	0-1000	×0.1%	M_ME	R	
+11	0xD0B	Low L-L voltage	0-Vmax	U1	M_ME	R	
+12	0xD0C	Low voltage interharmonics THD	0-9999	×0.1%	M_ME	R	
+13	0xD0D	Low current interharmonics THD	0-9999	×0.1%	M_ME	R	
19840-19855	<b>1/2-Cycle Analog Inputs</b>						
+0	0xD80	Analog input AI1	AI1min-AI1max		M_ME	R	
+1	0xD81	Analog input AI2	AI2min-AI2max		M_ME	R	
		...					
+15	0xD8F	Analog input AI16	AI16min-AI16max		M_ME	R	
19968-19981	<b>1-Cycle High Phase Values</b>						
+0	0xE00	High L-N voltage	0-Vmax	U1	M_ME	R	
+1	0xE01	High current	0-Imax	U2	M_ME	R	
+2	0xE02	High kW	-Pmax-Pmax	U3	M_ME	R	
+3	0xE03	High kvar	-Pmax-Pmax	U3	M_ME	R	
+4	0xE04	High kVA	0-Pmax	U3	M_ME	R	
+5	0xE05	High PF Lag	0-1000	×0.001	M_ME	R	
+6	0xE06	High PF Lead	0-1000	×0.001	M_ME	R	
+7	0xE07	High voltage THD	0-9999	×0.1%	M_ME	R	
+8	0xE08	High current THD	0-9999	×0.1%	M_ME	R	
+9	0xE09	High K-Factor	10-9999	×0.1	M_ME	R	
+10	0xE0A	High current TDD	0-1000	×0.1%	M_ME	R	
+11	0xE0B	High L-L voltage	0-Vmax	U1	M_ME	R	
+12	0xE0C	High voltage interharmonics THD	0-9999	×0.1%	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+13	0x0E0D	High current interharmonics THD	0-9999	×0.1%	M_ME	R	
20096-20111		<b>1-Second Analog Inputs</b>					
+0	0x0E80	Analog input AI1	AI1min-AI1max		M_ME	R	
+1	0x0E81	Analog input AI2	AI2min-AI2max		M_ME	R	
		...					
+15	0x0E8F	Analog input AI16	AI16min-AI16max		M_ME	R	
20224-20237		<b>1-Cycle Total Values</b>					
+0	0x0F00	Total kW	-Pmax-Pmax	U3	M_ME	R	
+1	0x0F01	Total kvar	-Pmax-Pmax	U3	M_ME	R	
+2	0x0F02	Total kVA	0-Pmax	U3	M_ME	R	
+3	0x0F03	Total PF	-1.000-1.000	0.001	M_ME	R	
+4	0x0F04	Total PF lag	0-1000	0.001	M_ME	R	
+5	0x0F05	Total PF lead	0-1000	0.001	M_ME	R	
+6	0x0F06	Total kW import	0-Pmax	U3	M_ME	R	
+7	0x0F07	Total kW export	0-Pmax	U3	M_ME	R	
+8	0x0F08	Total kvar import	0-Pmax	U3	M_ME	R	
+9	0x0F09	Total kvar export	0-Pmax	U3	M_ME	R	
+10	0x0F0A	3-phase average L-N	0-Vmax	U1	M_ME	R	<sup>1</sup>
+11	0x0F0B	3-phase average L-L voltage	0-Vmax	U1	M_ME	R	
+12	0x0F0C	3-phase average current	0-Imax	U2	M_ME	R	
+13	0x0F0D	3-phase average current, extended inputs I1x-I3x	0-Ixmax	U2	M_ME	R	
20480-20488		<b>1-Cycle Auxiliary Values</b>					
+0	0x1000	I4 current			M_ME	R	
+1	0x1001	In current	0-Imax	U2	M_ME	R	
+2	0x1002	Frequency	0-Fmax	0.01Hz	M_ME	R	
+3	0x1003	Voltage unbalance	0-300	1%	M_ME	R	
+4	0x1004	Current unbalance	0-300	1%	M_ME	R	
+5	0x1005	Not used			M_ME	R	
+6	0x1006	V4 voltage	0-V4max	U4	M_ME	R	
+7	0x1007	I4x current	0-Ixmax	U2	M_ME	R	
+8	0x1008	Frequency	0-100000	×0.001Hz	M_ME	R	
20608-20623		<b>Fundamental Phasor Values</b>					
+0	0x1080	V1 voltage magnitude	0-Vmax	U1	M_ME	R	<sup>2</sup>
+1	0x1081	V2 voltage magnitude	0-Vmax	U1	M_ME	R	<sup>2</sup>
+2	0x1082	V3 voltage magnitude	0-Vmax	U1	M_ME	R	<sup>2</sup>
+3	0x1083	V4 voltage magnitude	0-V4max		M_ME	R	
+4	0x1084	I1 current magnitude	0-Imax	U2	M_ME	R	
+5	0x1085	I2 current magnitude	0-Imax	U2	M_ME	R	
+6	0x1086	I3 current magnitude	0-Imax	U2	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+7	0x1087	I4 current magnitude	0-Imax		M_ME	R	
+8	0x1088	V1 voltage angle	-1800-1800	0.1°	M_ME	R	2
+9	0x1089	V2 voltage angle	-1800-1800	0.1°	M_ME	R	2
+10	0x108A	V3 voltage angle	-1800-1800	0.1°	M_ME	R	2
+11	0x108B	V4 voltage angle	-1800-1800	0.1°	M_ME	R	
+12	0x108C	I1 current angle	-1800-1800	0.1°	M_ME	R	
+13	0x108D	I2 current angle	-1800-1800	0.1°	M_ME	R	
+14	0x108E	I3 current angle	-1800-1800	0.1°	M_ME	R	
+15	0x108F	I4 current angle	-1800-1800	0.1°	M_ME	R	
20736-20774	<b>1-Second Phase Values</b>						
+0	0x1100	V1 voltage	0-Vmax	U1	M_ME	R	1
+1	0x1101	V2 voltage	0-Vmax	U1	M_ME	R	1
+2	0x1102	V3 voltage	0-Vmax	U1	M_ME	R	1
+3	0x1103	I1 current	0-Imax	U2	M_ME	R	
+4	0x1104	I2 current	0-Imax	U2	M_ME	R	
+5	0x1105	I3 current	0-Imax	U2	M_ME	R	
+6	0x1106	kW L1	-Pmax-Pmax	U3	M_ME	R	
+7	0x1107	kW L2	-Pmax-Pmax	U3	M_ME	R	
+8	0x1108	kW L3	-Pmax-Pmax	U3	M_ME	R	
+9	0x1109	kvar L1	-Pmax-Pmax	U3	M_ME	R	
+10	0x110A	kvar L2	-Pmax-Pmax	U3	M_ME	R	
+11	0x110B	kvar L3	-Pmax-Pmax	U3	M_ME	R	
+12	0x110C	KVA L1	0-Pmax	U3	M_ME	R	
+13	0x110D	KVA L2	0-Pmax	U3	M_ME	R	
+14	0x110E	KVA L3	0-Pmax	U3	M_ME	R	
+15	0x110F	Power factor L1	-1000-1000	×0.001	M_ME	R	
+16	0x1110	Power factor L2	-1000-1000	×0.001	M_ME	R	
+17	0x1111	Power factor L3	-1000-1000	×0.001	M_ME	R	
+18	0x1112	V1 voltage THD	0-9999	×0.1%	M_ME	R	2, 5
+19	0x1113	V2 voltage THD	0-9999	×0.1%	M_ME	R	2, 5
+20	0x1114	V3 voltage THD	0-9999	×0.1%	M_ME	R	2, 5
+21	0x1115	I1 current THD	0-9999	×0.1%	M_ME	R	5
+22	0x1116	I2 current THD	0-9999	×0.1%	M_ME	R	5
+23	0x1117	I3 current THD	0-9999	×0.1%	M_ME	R	5
+24	0x1118	I1 K-Factor	10-9999	×0.1	M_ME	R	5
+25	0x1119	I2 K-Factor	10-9999	×0.1	M_ME	R	5
+26	0x111A	I3 K-Factor	10-9999	×0.1	M_ME	R	5
+27	0x111B	I1 current TDD	0-1000	×0.1%	M_ME	R	5
+28	0x111C	I2 current TDD	0-1000	×0.1%	M_ME	R	5

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+29	0x111D	I3 current TDD	0-1000	×0.1%	M_ME	R	5
+30	0x111E	V12 voltage	0-Vmax	U1	M_ME	R	
+31	0x111F	V23 voltage	0-Vmax	U1	M_ME	R	
+32	0x1120	V31 voltage	0-Vmax	U1	M_ME	R	
+33	0x1121	I1x current	0-Ixmax	U2	M_ME	R	
+34	0x1122	I2x current	0-Ixmax	U2	M_ME	R	
+35	0x1123	I3x current	0-Ixmax	U2	M_ME	R	
+36	0x1124	V1x Voltage	0-Vmax	U1	M_ME	R	Transient recorder V1 channel
+37	0x1125	V2x Voltage	0-Vmax	U1	M_ME	R	Transient recorder V2 channel
+38	0x1126	V3x Voltage	0-Vmax	U1	M_ME	R	Transient recorder V3 channel
20992-21005	<b>1-Second Low Phase Values</b>						
+0	0x1200	Low L-N voltage	0-Vmax	U1	M_ME	R	
+1	0x1201	Low current	0-Imax	U2	M_ME	R	
+2	0x1202	Low kW	-Pmax-Pmax	U3	M_ME	R	
+3	0x1203	Low kvar	-Pmax-Pmax	U3	M_ME	R	
+4	0x1204	Low kVA	0-Pmax	U3	M_ME	R	
+5	0x1205	Low PF Lag	0-1000	×0.001	M_ME	R	
+6	0x1206	Low PF Lead	0-1000	×0.001	M_ME	R	
+7	0x1207	Low voltage THD	0-9999	×0.1%	M_ME	R	2, 5
+8	0x1208	Low current THD	0-9999	×0.1%	M_ME	R	5
+9	0x1209	Low K-Factor	10-9999	×0.1	M_ME	R	5
+10	0x120A	Low current TDD	0-1000	×0.1%	M_ME	R	5
+11	0x120B	Low L-L voltage	0-Vmax	U1	M_ME	R	
+12	0x120C	Low voltage interharmonics THD	0-9999	×0.1%	M_ME	R	2, 5
+13	0x120D	Low current interharmonics THD	0-9999	×0.1%	M_ME	R	5
21248-21261	<b>1-Second High Phase Values</b>						
+0	0x1300	High L-N voltage	0-Vmax	U1	M_ME	R	
+1	0x1301	High current	0-Imax	U2	M_ME	R	
+2	0x1302	High kW	-Pmax-Pmax	U3	M_ME	R	
+3	0x1303	High kvar	-Pmax-Pmax	U3	M_ME	R	
+4	0x1304	High kVA	0-Pmax	U3	M_ME	R	
+5	0x1305	High PF Lag	0-1000	×0.001	M_ME	R	
+6	0x1306	High PF Lead	0-1000	×0.001	M_ME	R	
+7	0x1307	High voltage THD	0-9999	×0.1%	M_ME	R	2, 5
+8	0x1308	High current THD	0-9999	×0.1%	M_ME	R	5
+9	0x1309	High K-Factor	10-9999	×0.1	M_ME	R	5
+10	0x130A	High current TDD	0-1000	×0.1%	M_ME	R	5
+11	0x130B	High L-L voltage	0-Vmax	U1	M_ME	R	
+12	0x130C	High voltage interharmonics THD	0-9999	×0.1%	M_ME	R	2, 5

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+13	0x130D	High current interharmonics THD	0-9999	×0.1%	M_ME	R	5
21504-21517		<b>1-Second Total Values</b>					
+0	0x1400	Total kW	-Pmax-Pmax	U3	M_ME	R	
+1	0x1401	Total kvar	-Pmax-Pmax	U3	M_ME	R	
+2	0x1402	Total KVA	0-Pmax	U3	M_ME	R	
+3	0x1403	Total PF	-1000-1000	×0.001	M_ME	R	
+4	0x1404	Total PF lag	0-1000	×0.001	M_ME	R	
+5	0x1405	Total PF lead	0-1000	×0.001	M_ME	R	
+6	0x1406	Total kW import	0-Pmax	U3	M_ME	R	
+7	0x1407	Total kW export	0-Pmax	U3	M_ME	R	
+8	0x1408	Total kvar import	0-Pmax	U3	M_ME	R	
+9	0x1409	Total kvar export	0-Pmax	U3	M_ME	R	
+10	0x140A	3-phase average L-N	0-Vmax	U1	M_ME	R	
+11	0x140B	3-phase average L-L voltage	0-Vmax	U1	M_ME	R	
+12	0x140C	3-phase average current	0-Imax	U2	M_ME	R	
+13	0x140D	3-phase average current, extended inputs I1x-I3x	0-Ixmax	U2	M_ME	R	
21760-21770		<b>1-Second Auxiliary Values</b>					
+0	0x1500	I4 current	0-Imax	U2	M_ME	R	
+1	0x1501	In current	0-Imax	U2	M_ME	R	
+2	0x1502	Frequency	0-10000	×0.01Hz	M_ME	R	
+3	0x1503	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+4	0x1504	Current unbalance	0-3000	×0.1%	M_ME	R	
+5	0x1505	Not used			M_ME	R	
+6	0x1506	V4 voltage	0-V4max	U4	M_ME	R	
+7	0x1507	I4x current	0-Ixmax	U2	M_ME	R	
+8	0x1508	V4x (neutral-ground) voltage	0-Vmax	U1	M_ME	R	Transient recorder Vn channel
+9	0x1509	Internal temperature	-2000 to 2000	×0.1°C	M_ME	R	
+10	0x150A	Frequency	0-100000	×0.001Hz	M_ME	R	
21888-21899		<b>Present Harmonic Demands</b>					
+0	0x1580	V1 THD demand	0-9999	×0.1%	M_ME	R	
+1	0x1581	V2 THD demand	0-9999	×0.1%	M_ME	R	
+2	0x1582	V3 THD demand	0-9999	×0.1%	M_ME	R	
+3	0x1583	V4 THD demand	0-9999	×0.1%	M_ME	R	
+4	0x1584	I1 THD demand	0-9999	×0.1%	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+5	0x1585	I2 THD demand	0-9999	×0.1%	M_ME	R	
+6	0x1586	I3 THD demand	0-9999	×0.1%	M_ME	R	
+7	0x1587	I4 THD demand	0-9999	×0.1%	M_ME	R	
+8	0x1588	I1 TDD demand	0-1000	×0.1%	M_ME	R	
+9	0x1589	I2 TDD demand	0-1000	×0.1%	M_ME	R	
+10	0x158A	I3 TDD demand	0-1000	×0.1%	M_ME	R	
+11	0x158B	I4 TDD demand	0-1000	×0.1%	M_ME	R	
22016-22050		<b>Present Demands</b>					
+0	0x1600	V1 volt demand	0-Vmax	U1	M_ME	R	2
+1	0x1601	V2 volt demand	0-Vmax	U1	M_ME	R	2
+2	0x1602	V3 volt demand	0-Vmax	U1	M_ME	R	2
+3	0x1603	I1 ampere demand	0-Imax	U2	M_ME	R	
+4	0x1604	I2 ampere demand	0-Imax	U2	M_ME	R	
+5	0x1605	I3 ampere demand	0-Imax	U2	M_ME	R	
+6	0x1606	kW import block demand	0-Pmax	U3	M_ME	R	
+7	0x1607	kvar import block demand	0-Pmax	U3	M_ME	R	
+8	0x1608	kVA block demand	0-Pmax	U3	M_ME	R	
+9	0x1609	kW import sliding window demand	0-Pmax	U3	M_ME	R	
+10	0x160A	kvar import sliding window demand	0-Pmax	U3	M_ME	R	
+11	0x160B	kVA sliding window demand	0-Pmax	U3	M_ME	R	
+12	0x160C	Not used	0		M_ME	R	
+13	0x160D	Not used	0		M_ME	R	
+14	0x160E	Not used	0		M_ME	R	
+15	0x160F	kW import accumulated demand	0-Pmax	U3	M_ME	R	
+16	0x1610	kvar import accumulated demand	0-Pmax	U3	M_ME	R	
+17	0x1611	kVA accumulated demand	0-Pmax	U3	M_ME	R	
+18	0x1612	kW import predicted sliding window demand	0-Pmax	U3	M_ME	R	
+19	0x1613	kvar import predicted sliding window demand	0-Pmax	U3	M_ME	R	
+20	0x1614	kVA predicted sliding window demand	0-Pmax	U3	M_ME	R	
+21	0x1615	PF (import) at Max. kVA sliding window demand	0-1000	×0.001	M_ME	R	
+22	0x1616	kW export block demand	0-Pmax	U3	M_ME	R	
+23	0x1617	kvar export block demand	0-Pmax	U3	M_ME	R	
+24	0x1618	kW export sliding window demand	0-Pmax	U3	M_ME	R	
+25	0x1619	kvar export sliding window demand	0-Pmax	U3	M_ME	R	
+26	0x161A	kW export accumulated demand	0-Pmax	U3	M_ME	R	
+27	0x161B	kvar export accumulated demand	0-Pmax	U3	M_ME	R	
+28	0x161C	kW export predicted sliding window demand	0-Pmax	U3	M_ME	R	
+29	0x161D	kvar export predicted sliding window demand	0-Pmax	U3	M_ME	R	
+30	0x161E	Not used	0		M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+31	0x161F	Not used	0		M_ME	R	
+32	0x1620	V4 volt demand	0-Vmax	U4	M_ME	R	
+33	0x1621	I4 ampere demand	0-Imax	U2	M_ME	R	
+34	0x1622	In ampere demand	0-Imax	U2	M_ME	R	
22656-22665		<b>Symmetrical Components</b>					
+0	0x1880	Positive-sequence voltage	0-Vmax	U1	M_ME	R	
+1	0x1881	Negative-sequence voltage	0-Vmax	U1	M_ME	R	
+2	0x1882	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+3	0x1883	Negative-sequence voltage unbalance	0-3000	$\times 0.1\%$	M_ME	R	
+4	0x1884	Zero-sequence voltage unbalance	0-3000	$\times 0.1\%$	M_ME	R	
+5	0x1885	Positive-sequence current	0-Imax	U2	M_ME	R	
+6	0x1886	Negative-sequence current	0-Imax	U2	M_ME	R	
+7	0x1887	Zero-sequence current	0-Imax	U2	M_ME	R	
+8	0x1888	Negative-sequence current unbalance	0-3000	$\times 0.1\%$	M_ME	R	
+9	0x1889	Zero-sequence current unbalance	0-3000	$\times 0.1\%$	M_ME	R	
22784-22846		<b>V1 Harmonics</b>					1
+0	0x1900	H01 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
+1	0x1901	H02 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
...		...					
+62	0x193E	H63 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
23040-23102		<b>V2 Harmonics</b>					1
+0	0x1A00	H01 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
+1	0x1A01	H02 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
...		...					
+62	0x1A3E	H63 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
23296-23358		<b>V3 Harmonics</b>					1
+0	0x1B00	H01 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
+1	0x1B01	H02 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
...		...					
+62	0x1B3E	H63 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
26624-26686		<b>V4 Harmonics</b>					
+0	0x2800	H01 Harmonic magnitude	0-10000	0.01%	M_ME	R	
+1	0x2801	H02 Harmonic magnitude	0-10000	0.01%	M_ME	R	
...		...					
+62	0x283E	H63 Harmonic magnitude	0-10000	0.01%	M_ME	R	
23552-23614		<b>I1 Harmonics</b>					
+0	0x1C00	H01 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	
+1	0x1C01	H02 Harmonic magnitude	0-10000	$\times 0.01\%$	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
...	...	...					
+62	0x1C3E	H63 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
23808-23870		<b>I2 Harmonics</b>					
+0	0x1D00	H01 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
+1	0x1D01	H02 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
...	...	...					
+62	0x1D3E	H63 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
24064-24126		<b>I3 Harmonics</b>					
+0	0x1E00	H01 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
+1	0x1E01	H02 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
...	...	...					
+62	0x1E3E	H63 Harmonic magnitude	0-10000	×0.01%	M_ME	R	
27392-27454		<b>I4 Harmonics</b>					
+0	0x2B00	H01 Harmonic magnitude	0-10000	0.01%	M_ME	R	
+1	0x2B01	H02 Harmonic magnitude	0-10000	0.01%	M_ME	R	
...	...	...					
+62	0x2B3E	H63 Harmonic magnitude	0-10000	0.01%	M_ME	R	
24320-24351		<b>V1 Harmonic Voltages (odd numbers)</b>					<sup>2</sup>
+0	0x1F00	H01 Harmonic voltage	0-Vmax	U1	M_ME	R	
+1	0x1F01	H03 Harmonic voltage	0-Vmax	U1	M_ME	R	
...	...	...					
+31	0x1F1E	H63 Harmonic voltage	0-Vmax	U1	M_ME	R	
24576-24607		<b>V2 Harmonic Voltages (odd numbers)</b>					<sup>2</sup>
+0	0x2000	H01 Harmonic voltage	0-Vmax	U1	M_ME	R	
+1	0x2001	H03 Harmonic voltage	0-Vmax	U1	M_ME	R	
...	...	...					
+31	0x201E	H63 Harmonic voltage	0-Vmax	U1	M_ME	R	
24832-24863		<b>V3 Harmonic Voltages (odd numbers)</b>					<sup>2</sup>
+0	0x2100	H01 Harmonic voltage	0-Vmax	U1	M_ME	R	
+1	0x2101	H03 Harmonic voltage	0-Vmax	U1	M_ME	R	
...	...	...					
+31	0x211E	H63 Harmonic voltage	0-Vmax	U1	M_ME	R	
28928-28959		<b>V4 Harmonic Voltages (odd numbers)</b>					
+0	0x3100	H01 Harmonic voltage	0-Vmax	U1	M_ME	R	
+1	0x3101	H03 Harmonic voltage	0-Vmax	U1	M_ME	R	
...	...	...					
+31	0x311E	H63 Harmonic voltage	0-Vmax	U1	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
25088-25119		<b>I1 Harmonic Currents (odd numbers)</b>					
+0	0x2200	H01 Harmonic current	0-Imax	U2	M_ME	R	
+1	0x2201	H03 Harmonic current	0-Imax	U2	M_ME	R	
		...					
+31	0x221E	H63 Harmonic current	0-Imax	U2	M_ME	R	
25344-25375		<b>I2 Harmonic Currents (odd numbers)</b>					
+0	0x2300	H01 Harmonic current	0-Imax	U2	M_ME	R	
+1	0x2301	H03 Harmonic current	0-Imax	U2	M_ME	R	
		...					
+31	0x231E	H63 Harmonic current	0-Imax	U2	M_ME	R	
25600-25631		<b>I3 Harmonic Currents (odd numbers)</b>					
+0	0x2400	H01 Harmonic current	0-Imax	U2	M_ME	R	
+1	0x2401	H03 Harmonic current	0-Imax	U2	M_ME	R	
		...					
+31	0x241E	H63 Harmonic current	0-Imax	U2	M_ME	R	
29184-29115		<b>I4 Harmonic Currents (odd numbers)</b>					
+0	0x3200	H01 Harmonic current	0-Imax	U2	M_ME	R	
+1	0x3201	H03 Harmonic current	0-Imax	U2	M_ME	R	
		...					
+31	0x321E	H63 Harmonic current	0-Imax	U2	M_ME	R	
25856-25887		<b>Total Harmonic kW (odd numbers)</b>					
+0	0x2500	H01 Harmonic kW	-Pmax -Pmax	U3	M_ME	R	
+1	0x2501	H03 Harmonic kW	-Pmax -Pmax	U3	M_ME	R	
		...					
+31	0x251E	H63 Harmonic kW	-Pmax -Pmax	U3	M_ME	R	
26112-26143		<b>Total Harmonic kvar (odd numbers)</b>					
+0	0x2600	H01 Harmonic kvar	-Pmax -Pmax	U3	M_ME	R	
+1	0x2601	H03 Harmonic kvar	-Pmax -Pmax	U3	M_ME	R	
		...					
+31	0x261E	H63 Harmonic kvar	-Pmax -Pmax	U3	M_ME	R	
26368-26399		<b>Total Harmonic Power Factor (odd numbers)</b>					
+0	0x2700	H01 Harmonic PF	-1000-1000	×0.001	M_ME	R	
+1	0x2701	H03 Harmonic PF	-1000-1000	×0.001	M_ME	R	
		...					
+31	0x271E	H63 Harmonic PF	-1000-1000	×0.001	M_ME	R	
27008-27013		<b>Flicker</b>					
+0	0x2980	V1 Pst	0-10000	×0.01	M_ME	R	
+1	0x2981	V2 Pst	0-10000	×0.01	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+2	0x2982	V3 Pst	0-10000	×0.01	M_ME	R	
+3	0x2983	V1 Plt	0-10000	×0.01	M_ME	R	
+4	0x2984	V2 Plt	0-10000	×0.01	M_ME	R	
+5	0x2985	V3 Plt	0-10000	×0.01	M_ME	R	
27648-27683	<b>Minimum 1-Cycle Phase Values</b>						
+0	0x2C00	V1 voltage	0-Vmax	U1	M_ME	R	1
+1	0x2C01	V2 voltage	0-Vmax	U1	M_ME	R	1
+2	0x2C02	V3 voltage	0-Vmax	U1	M_ME	R	1
+3	0x2C03	I1 current	0-Imax	U2	M_ME	R	
+4	0x2C04	I2 current	0-Imax	U2	M_ME	R	
+5	0x2C05	I3 current	0-Imax	U2	M_ME	R	
+6	0x2C06	kW L1	-Pmax-Pmax	U3	M_ME	R	
+7	0x2C07	kW L2	-Pmax-Pmax	U3	M_ME	R	
+8	0x2C08	kW L3	-Pmax-Pmax	U3	M_ME	R	
+9	0x2C09	kvar L1	-Pmax-Pmax	U3	M_ME	R	
+10	0x2C0A	kvar L2	-Pmax-Pmax	U3	M_ME	R	
+11	0x2C0B	kvar L3	-Pmax-Pmax	U3	M_ME	R	
+12	0x2C0C	KVA L1	0-Pmax	U3	M_ME	R	
+13	0x2C0D	KVA L2	0-Pmax	U3	M_ME	R	
+14	0x2C0E	KVA L3	0-Pmax	U3	M_ME	R	
+15	0x2C0F	Power factor L1	0-1000	×0.001	M_ME	R	Absolute value
+16	0x2C10	Power factor L2	0-1000	×0.001	M_ME	R	Absolute value
+17	0x2C11	Power factor L3	0-1000	×0.001	M_ME	R	Absolute value
+18	0x2C12	V1 voltage THD	0-9999	×0.1%	M_ME	R	2, 4
+19	0x2C13	V2 voltage THD	0-9999	×0.1%	M_ME	R	2, 4
+20	0x2C14	V3 voltage THD	0-9999	×0.1%	M_ME	R	2, 4
+21	0x2C15	I1 current THD	0-9999	×0.1%	M_ME	R	4
+22	0x2C16	I2 current THD	0-9999	×0.1%	M_ME	R	4
+23	0x2C17	I3 current THD	0-9999	×0.1%	M_ME	R	4
+24	0x2C18	I1 K-Factor	10-9999	×0.1	M_ME	R	4
+25	0x2C19	I2 K-Factor	10-9999	×0.1	M_ME	R	4
+26	0x2C1A	I3 K-Factor	10-9999	×0.1	M_ME	R	4
+27	0x2C1B	I1 current TDD	0-1000	×0.1%	M_ME	R	4
+28	0x2C1C	I2 current TDD	0-1000	×0.1%	M_ME	R	4
+29	0x2C1D	I3 current TDD	0-1000	×0.1%	M_ME	R	4
+30	0x2C1E	V12 voltage	0-Vmax	U1	M_ME	R	
+31	0x2C1F	V23 voltage	0-Vmax	U1	M_ME	R	
+32	0x2C20	V31 voltage	0-Vmax	U1	M_ME	R	
+33	0x2C21	I1x current	0-Ixmax	U2	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
	+34	0x2C22	I2x current	0-Ixmax	U2	M_ME	R
	+35	0x2C23	I3x current	0-Ixmax	U2	M_ME	R
27904-27909		<b>Minimum 1-Cycle Total Values</b>					
	+0	0x2D00	Total kW	-Pmax-Pmax	U3	M_ME	R
	+1	0x2D01	Total kvar	-Pmax-Pmax	U3	M_ME	R
	+2	0x2D02	Total kVA	0-Pmax	U3	M_ME	R
	+3	0x2D03	Total PF	0-1000	×0.001	M_ME	R
	+4	0x2D04	Total PF lag	0-1000	×0.001	M_ME	R
	+5	0x2D05	Total PF lead	0-1000	×0.001	M_ME	R
28160-28170		<b>Minimum 1-Cycle Auxiliary Values</b>					
	+0	0x2E00	I4 current	0-Imax	U2	M_ME	R
	+1	0x2E01	In current	0-Imax	U2	M_ME	R
	+2	0x2E02	Frequency	0-10000	×0.01Hz	M_ME	R
	+3	0x2E03	Voltage unbalance	0-3000	×0.1%	M_ME	R
	+4	0x2E04	Current unbalance	0-3000	×0.1%	M_ME	R
	+5	0x2E05	Not used				R
	+6	0x2E06	V4 voltage	0-V4max	U4	M_ME	R
	+7	0x2E07	I4x current	0-Ixmax	U2	M_ME	R
	+8	0x2E08	V4 THD	0-9999	×0.1%	M_ME	R
	+9	0x2E09	I4x THD	0-9999	×0.1%	M_ME	R
	+10	0x2E0A	I4x TDD	0-1000	×0.1%	M_ME	R
17728-17759		<b>Minimum Analog Inputs</b>					
	+0	0x2E80	Analog input AI1	AI1min-AI1max		M_ME	R
	+1	0x2E81	Analog input AI2	AI2min-AI2max		M_ME	R
		...					
	+15	0x2E8F	Analog input AI16	AI16min-AI16max		M_ME	R
17920-17951		<b>Programmable Min/Max Minimum Values</b>					
	+0	0x3000	Min/Max Register #1			M_ME	R
	+1	0x3001	Min/Max Register #2			M_ME	R
		...					
	+15	0x300F	Min/Max Register #16			M_ME	R
18432-18503		<b>Maximum 1-Cycle Phase Values</b>					
	+0	0x3400	V1 voltage	0-Vmax	U1	M_ME	R
	+1	0x3401	V2 voltage	0-Vmax	U1	M_ME	R
	+2	0x3402	V3 voltage	0-Vmax	U1	M_ME	R
	+3	0x3403	I1 current	0-Imax	U2	M_ME	R
	+4	0x3404	I2 current	0-Imax	U2	M_ME	R
	+5	0x3405	I3 current	0-Imax	U2	M_ME	R
	+6	0x3406	kW L1	-Pmax-Pmax	U3	M_ME	R

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+7	0x3407	kW L2	-Pmax-Pmax	U3	M_ME	R	
+8	0x3408	kW L3	-Pmax-Pmax	U3	M_ME	R	
+9	0x3409	kvar L1	-Pmax-Pmax	U3	M_ME	R	
+10	0x340A	kvar L2	-Pmax-Pmax	U3	M_ME	R	
+11	0x340B	kvar L3	-Pmax-Pmax	U3	M_ME	R	
+12	0x340C	KVA L1	0-Pmax	U3	M_ME	R	
+13	0x340D	KVA L2	0-Pmax	U3	M_ME	R	
+14	0x340E	KVA L3	0-Pmax	U3	M_ME	R	
+15	0x340F	Power factor L1	0-1000	×0.001	M_ME	R	Absolute value
+16	0x3410	Power factor L2	0-1000	×0.001	M_ME	R	Absolute value
+17	0x3411	Power factor L3	0-1000	×0.001	M_ME	R	Absolute value
+18	0x3412	V1 voltage THD	0-9999	×0.1%	M_ME	R	2, 4
+19	0x3413	V2 voltage THD	0-9999	×0.1%	M_ME	R	2, 4
+20	0x3414	V3 voltage THD	0-9999	×0.1%	M_ME	R	2, 4
+21	0x3415	I1 current THD	0-9999	×0.1%	M_ME	R	4
+22	0x3416	I2 current THD	0-9999	×0.1%	M_ME	R	4
+23	0x3417	I3 current THD	0-9999	×0.1%	M_ME	R	4
+24	0x3418	I1 K-Factor	10-9999	×0.1	M_ME	R	4
+25	0x3419	I2 K-Factor	10-9999	×0.1	M_ME	R	4
+26	0x341A	I3 K-Factor	10-9999	×0.1	M_ME	R	4
+27	0x341B	I1 current TDD	0-1000	×0.1%	M_ME	R	4
+28	0x341C	I2 current TDD	0-1000	×0.1%	M_ME	R	4
+29	0x341D	I3 current TDD	0-1000	×0.1%	M_ME	R	4
+30	0x341E	V12 voltage	0-Vmax	U1	M_ME	R	
+31	0x341F	V23 voltage	0-Vmax	U1	M_ME	R	
+32	0x3420	V31 voltage	0-Vmax	U1	M_ME	R	
+33	0x3421	I1x current	0-Ixmax	U2	M_ME	R	
+34	0x3422	I2x current	0-Ixmax	U2	M_ME	R	
+35	0x3423	I3x current	0-Ixmax	U2	M_ME	R	
18560-18571	<b>Maximum 1-Cycle Total Values</b>						
+0	0x3500	Total kW	-Pmax-Pmax	U3	M_ME	R	
+1	0x3501	Total kvar	-Pmax-Pmax	U3	M_ME	R	
+2	0x3502	Total KVA	0-Pmax	U3	M_ME	R	
+3	0x3503	Total PF	0-1000	×0.001	M_ME	R	Absolute value
+4	0x3504	Total PF lag	0-1000	×0.001	M_ME	R	
+5	0x3505	Total PF lead	0-1000	×0.001	M_ME	R	
18668-18689	<b>Maximum 1-Cycle Auxiliary Values</b>						
+0	0x3600	I4 current	0-Imax	U2	M_ME	R	
+1	0x3601	In current	0-Imax	U2	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+2	0x3602	Frequency	0-10000	×0.01Hz	M_ME	R	
+3	0x3603	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+4	0x3604	Current unbalance	0-3000	×0.1%	M_ME	R	
+5	0x3605	Not used			M_ME	R	
+6	0x3606	V4 voltage	0-V4max	U4	M_ME	R	
+7	0x3607	I4x current	0-Ixmax	U2	M_ME	R	
+8	0x3608	V4 THD	0-9999	×0.1%	M_ME	R	<sup>4</sup>
+9	0x3609	I4x THD	0-9999	×0.1%	M_ME	R	<sup>4</sup>
+10	0x360A	I4x TDD	0-1000	×0.1%	M_ME	R	<sup>4</sup>
18732-18795		<b>Maximum Analog Inputs</b>					
+0	0x3680	Analog input AI1	AI1min-AI1max		M_ME	R	
+1	0x3681	Analog input AI2	AI2min-AI2max		M_ME	R	
		...					
+15	0x368F	Analog input AI16	AI16min-AI16max		M_ME	R	
18816-18859		<b>Maximum Demands</b>					
+0	0x3700	V1 Maximum volt demand	0-Vmax	U1	M_ME	R	<sup>2</sup>
+1	0x3701	V2 Maximum volt demand	0-Vmax	U1	M_ME	R	<sup>2</sup>
+2	0x3702	V3 Maximum volt demand	0-Vmax	U1	M_ME	R	<sup>2</sup>
+3	0x3703	I1 Maximum ampere demand	0-Imax	U2	M_ME	R	
+4	0x3704	I2 Maximum ampere demand	0-Imax	U2	M_ME	R	
+5	0x3705	I3 Maximum ampere demand	0-Imax	U2	M_ME	R	
+6	0x3706	Not used	0		M_ME	R	
+7	0x3707	Not used	0		M_ME	R	
+8	0x3708	Not used	0		M_ME	R	
+9	0x3709	Maximum kW import sliding window demand	0-Pmax	U3	M_ME	R	
+10	0x370A	Maximum kvar import sliding window demand	0-Pmax	U3	M_ME	R	
+11	0x370B	Maximum kVA sliding window demand	0-Pmax	U3	M_ME	R	
+12	0x3737	Not used	0		M_ME	R	
+13	0x370D	Not used	0		M_ME	R	
+14	0x370E	Not used	0		M_ME	R	
+15	0x370F	Maximum kW export sliding window demand	0-Pmax	U3	M_ME	R	
+16	0x3710	Maximum kvar export sliding window demand	0-Pmax	U3	M_ME	R	
+17	0x3737	Not used	0		M_ME	R	
+18	0x3712	Not used	0		M_ME	R	
+19	0x3713	V4 Maximum volt demand	0-Vmax	U4	M_ME	R	
+20	0x3714	I4 Maximum ampere demand	0-I4max	U2	M_ME	R	
+21	0x3715	In Maximum ampere demand	0-Imax	U2	M_ME	R	
18944-18975		<b>Programmable Min/Max Maximum Values</b>					
+0	0x3800	Min/Max Register #1			M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
	+1	Min/Max Register #2			M_ME	R	
		...					
	+15	Min/Max Register #16			M_ME	R	
19008-19031		<b>Maximum Harmonic Demands</b>					
	+0	V1 THD demand	0-9999	×0.1%	M_ME	R	2
	+1	V2 THD demand	0-9999	×0.1%	M_ME	R	2
	+2	V3 THD demand	0-9999	×0.1%	M_ME	R	2
	+3	V4 THD demand	0-9999	×0.1%	M_ME	R	
	+4	I1 THD demand	0-9999	×0.1%	M_ME	R	
	+5	I2 THD demand	0-9999	×0.1%	M_ME	R	
	+6	I3 THD demand	0-9999	×0.1%	M_ME	R	
	+7	I4 THD demand	0-9999	×0.1%	M_ME	R	
	+8	I1 TDD demand	0-1000	×0.1%	M_ME	R	
	+9	I2 TDD demand	0-1000	×0.1%	M_ME	R	
	+10	I3 TDD demand	0-1000	×0.1%	M_ME	R	
	+11	I4 TDD demand	0-1000	×0.1%	M_ME	R	
19072-19135		<b>Maximum Analog Input Demands</b>					
	+0	Analog input AI1+	AI1min-AI1max		M_ME	R	Positive AI readings demand
	+1	Analog input AI2+	AI2min-AI2max		M_ME	R	
		...					
	+15	Analog input AI16+	AI16min-AI16max		M_ME	R	
	+16	Analog input AI1-	AI1min-AI1max		M_ME	R	Negative AI readings demand
	+17	Analog input AI2-	AI2min-AI2max		M_ME	R	
		...					
	+31	Analog input AI16-	AI16min-AI16max		M_ME	R	
19200-19263		<b>Present Analog Input Demands</b>					
	+0	Analog input AI1+	AI1min-AI1max		M_ME	R	Positive AI readings demand
	+1	Analog input AI2+	AI2min-AI2max		M_ME	R	
		...					
	+15	Analog input AI16+	AI16min-AI16max		M_ME	R	
	+16	Analog input AI1-	AI1min-AI1max		M_ME	R	Negative AI readings demand
	+17	Analog input AI2-	AI2min-AI2max		M_ME	R	
		...					
	+31	Analog input AI16-	AI16min-AI16max		M_ME	R	
19328-19359		<b>1-Cycle Analog Inputs</b>					
	+0	Analog input AI1	AI1min-AI1max		M_ME	R	
	+1	Analog input AI2	AI2min-AI2max		M_ME	R	
		...					
	+15	Analog input AI16	AI16min-AI16max		M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
19392-19423		<b>Raw Analog Inputs</b>					
	+0	0x3B80 Analog input AI1	0-4095		M_ME	R	
	+1	0x3B81 Analog input AI2	0-4095		M_ME	R	
		...					
	+15	0x3B8F Analog input AI16	0-4095		M_ME	R	
19456-19459		<b>TOU Parameters</b>					
	+0	0x3C00 Active tariff	0-15 = Tariff 1-16		M_ME	R/W	
	+1	0x3C01 Active profile	0-15 = Profile 1-16		M_ME	R	
19520-19551		<b>Scaled Analog Outputs</b>					
	+0	0x3C80 Analog input AO1	0-4095		M_ME	R/W	
	+1	0x3C81 Analog input AO2	0-4095		M_ME	R/W	
		...					
	+15	0x3C8F Analog input AO16	0-4095		M_ME	R/W	
34048-34063		<b>Billing Summary Accumulated Demands</b>					
	+0	0x4500 Summary register #1	0-Pmax	U3	M_ME	R	
	+1	0x4501 Summary register #2	0-Pmax	U3	M_ME	R	
		...					
	+15	0x450F Summary register #16	0-Pmax	U3	M_ME	R	
34176-34191		<b>Billing Summary Block Demands</b>					
	+0	0x4580 Summary register #1	0-Pmax	U3	M_ME	R	
	+1	0x4581 Summary register #2	0-Pmax	U3	M_ME	R	
		...					
	+15	0x458F Summary register #16	0-Pmax	U3	M_ME	R	
34304-34319		<b>Billing Summary Sliding Window Demands</b>					
	+0	0x4600 Summary register #1	0-Pmax	U3	M_ME	R	
	+1	0x4601 Summary register #2	0-Pmax	U3	M_ME	R	
		...					
	+15	0x460F Summary register #16	0-Pmax	U3	M_ME	R	
34688-34703		<b>Billing Summary Maximum Demands</b>					
	+0	0x4780 Summary register #1	0-Pmax	U3	M_ME	R	
	+1	0x4781 Summary register #2	0-Pmax	U3	M_ME	R	
		...					
	+15	0x4783 Summary register #16	0-Pmax	U3	M_ME	R	
34816-34831		<b>Billing TOU Maximum Demand Register #1</b>					
	+0	0x4800 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x4801 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...			R		
	+15	0x480F Tariff #16 register	0-Pmax	U3	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
34944-34959		<b>Billing TOU Maximum Demand Register #4</b>					
	+0	0x4880 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x4881 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x488F Tariff #16 register	0-Pmax	U3	M_ME	R	
35072-35087		<b>Billing TOU Maximum Demand Register #2</b>					
	+0	0x4900 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x4901 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x490F Tariff #16 register	0-Pmax	U3	M_ME	R	
35200-35215		<b>Billing TOU Maximum Demand Register #5</b>					
	+0	0x4980 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x4981 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x498F Tariff #16 register	0-Pmax	U3	M_ME	R	
35328-35343		<b>Billing TOU Maximum Demand Register #3</b>					
	+0	0x4A00 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x4A01 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x4A0F Tariff #16 register	0-Pmax	U3	M_ME	R	
35456-35471		<b>Billing TOU Maximum Demand Register #6</b>					
	+0	0x4A80 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x4A81 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x4A8F Tariff #16 register	0-Pmax	U3	M_ME	R	
37632-37647		<b>Billing TOU Maximum Demand Register #7</b>					
	+0	0x5300 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x5301 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x530F Tariff #16 register	0-Pmax	U3	M_ME	R	
37760-37765		<b>Billing TOU Maximum Demand Register #8</b>					
	+0	0x5380 Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1	0x5381 Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15	0x538F Tariff #16 register	0-Pmax	U3	M_ME	R	
37888-37903		<b>Billing TOU Maximum Demand Register #9</b>					
	+0	0x5400 Tariff #1 register	0-Pmax	U3	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
	+1 0x5401	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x540F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38016-38031		<b>Billing TOU Maximum Demand Register #10</b>					
	+0 0x5480	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5481	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x548F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38144-38159		<b>Billing TOU Maximum Demand Register #11</b>					
	+0 0x5500	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5501	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x550F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38272-38287		<b>Billing TOU Maximum Demand Register #12</b>					
	+0 0x5580	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5581	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x558F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38400-38415		<b>Billing TOU Maximum Demand Register #13</b>					
	+0 0x5600	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5601	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x560F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38528-38543		<b>Billing TOU Maximum Demand Register #14</b>					
	+0 0x5680	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5681	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x568F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38656-38671		<b>Billing TOU Maximum Demand Register #15</b>					
	+0 0x5700	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5701	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	
	+15 0x570F	Tariff #16 register	0-Pmax	U3	M_ME	R	
38784-38799		<b>Billing TOU Maximum Demand Register #16</b>					
	+0 0x5780	Tariff #1 register	0-Pmax	U3	M_ME	R	
	+1 0x5781	Tariff #2 register	0-Pmax	U3	M_ME	R	
		...				R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+15	0x578F	Tariff #16 register	0-Pmax	U3	M_ME	R	
41984-42046		<b>V1/V12 Harmonic Angles</b>					2, 6
+0	0x6400	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6401	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x643E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
42240-42302		<b>V2/V23 Harmonic Angles</b>					2, 6
+0	0x6500	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6501	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x653E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
42496-42558		<b>V3/V31 Harmonic Angles</b>					2, 6
+0	0x6600	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6601	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x663E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
42752-42814		<b>V4 Harmonic Angles</b>					6
+0	0x6700	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6701	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x673E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
43008-43070		<b>I1 Harmonic Angles</b>					6
+0	0x6800	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6801	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x683E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
43264-43326		<b>I2 Harmonic Angles</b>					6
+0	0x6900	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6901	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x693E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
43520-43582		<b>I3 Harmonic Angles</b>					6
+0	0x6A00	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6A01	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
		...					
+62	0x6A3E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
43776-43838		<b>I4 Harmonic Angles</b>					6
+0	0x6B00	H01 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
+1	0x6B01	H02 Harmonic angle	-1800-1800	×0.1°	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
		...					
+62	0x6B3E	H63 Harmonic angle	-1800-1800	×0.1°	M_ME	R	
44032-44058		<b>0.2-Second RMS and Auxiliary Values</b>					
+0	0x6C00	V1 voltage	0-Vmax	U1	M_ME	R	1
+1	0x6C01	V2 voltage	0-Vmax	U1	M_ME	R	1
+2	0x6C02	V3 voltage	0-Vmax	U1	M_ME	R	1
+3	0x6C03	V4 voltage	0-V4max	U4	M_ME	R	
+4	0x6C04	V12 voltage	0-Vmax	U1	M_ME	R	
+5	0x6C05	V23 voltage	0-Vmax	U1	M_ME	R	
+6	0x6C06	V31 voltage	0-Vmax	U1	M_ME	R	
+7	0x6C07	I1 current	0-Imax	U2	M_ME	R	
+8	0x6C08	I2 current	0-Imax	U2	M_ME	R	
+9	0x6C09	I3 current	0-Imax	U2	M_ME	R	
+10	0x6C0A	I4 current	0-I4max	U2	M_ME	R	
+11	0x6C0B	In current	0-Imax	U2	M_ME	R	
+12	0x6C0C	I1x current	0-Ixmax	U2	M_ME	R	
+13	0x6C0D	I2x current	0-Ixmax	U2	M_ME	R	
+14	0x6C0E	I3x current	0-Ixmax	U2	M_ME	R	
+15	0x6C0F	I4x current	0-I4xmax	U2	M_ME	R	
+16	0x6C10	Inx current	0-Ixmax	U2	M_ME	R	
+17	0x6C11	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+18	0x6C12	Zero-sequence current	0-Imax	U2	M_ME	R	
+19	0x6C13	Ix Zero-sequence current	0-Ixmax	U2	M_ME	R	
+20	0x6C14	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+21	0x6C15	Current unbalance	0-3000	×0.1%	M_ME	R	
+22	0x6C16	Ix current unbalance	0-3000	×0.1%	M_ME	R	
+23	0x6C17	Not used				R	
+24	0x6C18	Frequency	0-10000	×0.01Hz	M_ME	R	
+25	0x6C19	Positive-sequence voltage	0-Vmax	U1	M_ME	R	
+26	0x6C1A	Zero-sequence voltage unbalance	0-300.0	×0.1%	M_ME	R	
44160-44186		<b>3-Second RMS and Auxiliary Values</b>					
+0	0x6C80	V1 voltage	0-Vmax	U1	M_ME	R	1
+1	0x6C81	V2 voltage	0-Vmax	U1	M_ME	R	1
+2	0x6C82	V3 voltage	0-Vmax	U1	M_ME	R	1
+3	0x6C83	V4 voltage	0-V4max	U4	M_ME	R	
+4	0x6C84	V12 voltage	0-Vmax	U1	M_ME	R	
+5	0x6C85	V23 voltage	0-Vmax	U1	M_ME	R	
+6	0x6C86	V31 voltage	0-Vmax	U1	M_ME	R	
+7	0x6C87	I1 current	0-Imax	U2	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+8	0x6C88	I2 current	0-Imax	U2	M_ME	R	
+9	0x6C89	I3 current	0-Imax	U2	M_ME	R	
+10	0x6C8A	I4 current	0-I4max	U2	M_ME	R	
+11	0x6C8B	In current	0-Imax	U2	M_ME	R	
+12	0x6C8C	I1x current	0-Ixmax	U2	M_ME	R	
+13	0x6C8D	I2x current	0-Ixmax	U2	M_ME	R	
+14	0x6C8E	I3x current	0-Ixmax	U2	M_ME	R	
+15	0x6C8F	I4x current	0-I4xmax	U2	M_ME	R	
+16	0x6C90	Inx current	0-Ixmax	U2	M_ME	R	
+17	0x6C91	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+18	0x6C92	Zero-sequence current	0-Imax	U2	M_ME	R	
+19	0x6C93	Ix Zero-sequence current	0-Ixmax	U2	M_ME	R	
+20	0x6C94	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+21	0x6C95	Current unbalance	0-3000	×0.1%	M_ME	R	
+22	0x6C96	Ix current unbalance	0-3000	×0.1%	M_ME	R	
+23	0x6C97	Not used				R	
+24	0x6C98	Frequency	0-10000	×0.01Hz	M_ME	R	
+25	0x6C99	Positive-sequence voltage	0-Vmax	U1	M_ME	R	
+26	0x6C9A	Zero-sequence voltage unbalance	0-300.0	×0.1%	M_ME	R	
46592-46618	<b>1-Minute RMS and Auxiliary Values (GOST)</b>						
+0	0x7600	V1 voltage	0-Vmax	U1	M_ME	R	1
+1	0x7601	V2 voltage	0-Vmax	U1	M_ME	R	1
+2	0x7602	V3 voltage	0-Vmax	U1	M_ME	R	1
+3	0x7603	V4 voltage	0-V4max	U4	M_ME	R	
+4	0x7604	V12 voltage	0-Vmax	U1	M_ME	R	
+5	0x7605	V23 voltage	0-Vmax	U1	M_ME	R	
+6	0x7606	V31 voltage	0-Vmax	U1	M_ME	R	
+7	0x7607	I1 current	0-Imax	U2	M_ME	R	
+8	0x7608	I2 current	0-Imax	U2	M_ME	R	
+9	0x7609	I3 current	0-Imax	U2	M_ME	R	
+10	0x760A	I4 current	0-I4max	U2	M_ME	R	
+11	0x760B	In current	0-Imax	U2	M_ME	R	
+12	0x760C	I1x current	0-Ixmax	U2	M_ME	R	
+13	0x760D	I2x current	0-Ixmax	U2	M_ME	R	
+14	0x760E	I3x current	0-Ixmax	U2	M_ME	R	
+15	0x760F	I4x current	0-I4xmax	U2	M_ME	R	
+16	0x7610	Inx current	0-Ixmax	U2	M_ME	R	
+17	0x7611	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+18	0x7612	Zero-sequence current	0-Imax	U2	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+19	0x7613	Ix Zero-sequence current	0-Ixmax	U2	M_ME	R	
+20	0x7614	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+21	0x7615	Current unbalance	0-3000	×0.1%	M_ME	R	
+22	0x7616	Ix current unbalance	0-3000	×0.1%	M_ME	R	
+23	0x7617	DC voltage	0-999900	×0.01V	M_ME	R	
+24	0x7618	Frequency	0-10000	×0.01Hz	M_ME	R	
+25	0x7619	Positive-sequence voltage	0-Vmax	U1	M_ME	R	
+26	0x761A	Zero-sequence voltage unbalance	0-300.0	×0.1%	M_ME	R	
44288-44314		<b>10-Minute RMS and Auxiliary Values</b>					
+0	0x6D00	V1 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+1	0x6D01	V2 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+2	0x6D02	V3 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+3	0x6D03	V4 voltage	0-V4max	U4	M_ME	R	
+4	0x6D04	V12 voltage	0-Vmax	U1	M_ME	R	
+5	0x6D05	V23 voltage	0-Vmax	U1	M_ME	R	
+6	0x6D06	V31 voltage	0-Vmax	U1	M_ME	R	
+7	0x6D07	I1 current	0-Imax	U2	M_ME	R	
+8	0x6D08	I2 current	0-Imax	U2	M_ME	R	
+9	0x6D09	I3 current	0-Imax	U2	M_ME	R	
+10	0x6D0A	I4 current	0-I4max	U2	M_ME	R	
+11	0x6D0B	In current	0-Imax	U2	M_ME	R	
+12	0x6D0C	I1x current	0-Ixmax	U2	M_ME	R	
+13	0x6D0D	I2x current	0-Ixmax	U2	M_ME	R	
+14	0x6D0E	I3x current	0-Ixmax	U2	M_ME	R	
+15	0x6D0F	I4x current	0-I4xmax	U2	M_ME	R	
+16	0x6D10	Inx current	0-Ixmax	U2	M_ME	R	
+17	0x6D11	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+18	0x6D12	Zero-sequence current	0-Imax	U2	M_ME	R	
+19	0x6D13	Ix Zero-sequence current	0-Ixmax	U2	M_ME	R	
+20	0x6D14	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+21	0x6D15	Current unbalance	0-3000	×0.1%	M_ME	R	
+22	0x6D16	Ix current unbalance	0-3000	×0.1%	M_ME	R	
+23	0x6D17	Not used				R	
+24	0x6D18	Frequency	0-10000	×0.01Hz	M_ME	R	
+25	0x6D19	Positive-sequence voltage	0-Vmax	U1	M_ME	R	
+26	0x6D1A	Zero-sequence voltage unbalance	0-300.0	×0.1%	M_ME	R	
44416-44442		<b>2-Hour RMS and Auxiliary Values</b>					
+0	0x6D80	V1 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>
+1	0x6D81	V2 voltage	0-Vmax	U1	M_ME	R	<sup>1</sup>

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+2	0x6D82	V3 voltage	0-Vmax	U1	M_ME	R	1
+3	0x6D83	V4 voltage	0-V4max	U4	M_ME	R	
+4	0x6D84	V12 voltage	0-Vmax	U1	M_ME	R	
+5	0x6D85	V23 voltage	0-Vmax	U1	M_ME	R	
+6	0x6D86	V31 voltage	0-Vmax	U1	M_ME	R	
+7	0x6D87	I1 current	0-Imax	U2	M_ME	R	
+8	0x6D88	I2 current	0-Imax	U2	M_ME	R	
+9	0x6D89	I3 current	0-Imax	U2	M_ME	R	
+10	0x6D8A	I4 current	0-I4max	U2	M_ME	R	
+11	0x6D8B	In current	0-Imax	U2	M_ME	R	
+12	0x6D8C	I1x current	0-Ixmax	U2	M_ME	R	
+13	0x6D8D	I2x current	0-Ixmax	U2	M_ME	R	
+14	0x6D8E	I3x current	0-Ixmax	U2	M_ME	R	
+15	0x6D8F	I4x current	0-I4xmax	U2	M_ME	R	
+16	0x6D90	Inx current	0-Ixmax	U2	M_ME	R	
+17	0x6D91	Zero-sequence voltage	0-Vmax	U1	M_ME	R	
+18	0x6D92	Zero-sequence current	0-Imax	U2	M_ME	R	
+19	0x6D93	Ix Zero-sequence current	0-Ixmax	U2	M_ME	R	
+20	0x6D94	Voltage unbalance	0-3000	×0.1%	M_ME	R	
+21	0x6D95	Current unbalance	0-3000	×0.1%	M_ME	R	
+22	0x6D96	Ix current unbalance	0-3000	×0.1%	M_ME	R	
+23	0x6D97	Not used				R	
+24	0x6D98	Frequency	0-10000	×0.01Hz	M_ME	R	
+25	0x6D99	Positive-sequence voltage	0-Vmax	U1	M_ME	R	
+26	0x6D9A	Zero-sequence voltage unbalance	0-300.0	×0.1%	M_ME	R	
44544-44575		<b>0.2-Second Harmonics</b>					
+0	0x6E00	V1 THD	0-9999	×0.1%	M_ME	R	2
+1	0x6E01	V2 THD	0-9999	×0.1%	M_ME	R	2
+2	0x6E02	V3 THD	0-9999	×0.1%	M_ME	R	2
+3	0x6E03	V4 THD	0-9999	×0.1%	M_ME	R	
+4	0x6E04	I1 THD	0-9999	×0.1%	M_ME	R	
+5	0x6E05	I2 THD	0-9999	×0.1%	M_ME	R	
+6	0x6E06	I3 THD	0-9999	×0.1%	M_ME	R	
+7	0x6E07	I4 THD	0-9999	×0.1%	M_ME	R	
+8	0x6E08	V1 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+9	0x6E09	V2 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+10	0x6E0A	V3 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+11	0x6E0B	V4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+12	0x6E0C	I1 interharmonics THD	0-9999	×0.1%	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+13	0x6E0D	I2 interharmonics THD	0-9999	×0.1%	M_ME	R	
+14	0x6E0E	I3 interharmonics THD	0-9999	×0.1%	M_ME	R	
+15	0x6E0F	I4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+16	0x6E10	I1 TDD	0-1000	×0.1%	M_ME	R	
+17	0x6E11	I2 TDD	0-1000	×0.1%	M_ME	R	
+18	0x6E12	I3 TDD	0-1000	×0.1%	M_ME	R	
+19	0x6E13	I4 TDD	0-1000	×0.1%	M_ME	R	
+20	0x6E14	I1 K-Factor	10-9999	×0.1	M_ME	R	
+21	0x6E15	I2 K-Factor	10-9999	×0.1	M_ME	R	
+22	0x6E16	I3 K-Factor	10-9999	×0.1	M_ME	R	
+23	0x6E17	I4 K-Factor	10-9999	×0.1	M_ME	R	
+24	0x6E18	V1 Crest Factor	0-10000	×0.01	M_ME	R	2
+25	0x6E19	V2 Crest Factor	0-10000	×0.01	M_ME	R	2
+26	0x6E1A	V3 Crest Factor	0-10000	×0.01	M_ME	R	2
+27	0x6E1B	V4 Crest Factor	0-10000	×0.01	M_ME	R	
+28	0x6E1C	I1 Crest Factor	0-10000	×0.01	M_ME	R	
+29	0x6E1D	I2 Crest Factor	0-10000	×0.01	M_ME	R	
+30	0x6E1E	I3 Crest Factor	0-10000	×0.01	M_ME	R	
+31	0x6E1F	I4 Crest Factor	0-10000	×0.01	M_ME	R	
44672-44703		<b>3-Second Harmonics</b>					
+0	0x6E80	V1 THD	0-9999	×0.1%	M_ME	R	2
+1	0x6E81	V2 THD	0-9999	×0.1%	M_ME	R	2
+2	0x6E82	V3 THD	0-9999	×0.1%	M_ME	R	2
+3	0x6E83	V4 THD	0-9999	×0.1%	M_ME	R	
+4	0x6E84	I1 THD	0-9999	×0.1%	M_ME	R	
+5	0x6E85	I2 THD	0-9999	×0.1%	M_ME	R	
+6	0x6E86	I3 THD	0-9999	×0.1%	M_ME	R	
+7	0x6E87	I4 THD	0-9999	×0.1%	M_ME	R	
+8	0x6E88	V1 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+9	0x6E89	V2 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+10	0x6E8A	V3 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+11	0x6E8B	V4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+12	0x6E6E	I1 interharmonics THD	0-9999	×0.1%	M_ME	R	
+13	0x6E8D	I2 interharmonics THD	0-9999	×0.1%	M_ME	R	
+14	0x6E8E	I3 interharmonics THD	0-9999	×0.1%	M_ME	R	
+15	0x6E8F	I4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+16	0x6E90	I1 TDD	0-1000	×0.1%	M_ME	R	
+17	0x6E91	I2 TDD	0-1000	×0.1%	M_ME	R	
+18	0x6E92	I3 TDD	0-1000	×0.1%	M_ME	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>2</sup></b>	<b>Units and Resolution <sup>2</sup></b>	<b>Type <sup>4</sup></b>	<b>R/W</b>	<b>Notes</b>
+19	0x6E93	I4 TDD	0-1000	×0.1%	M_ME	R	
+20	0x6E94	I1 K-Factor	10-9999	×0.1	M_ME	R	
+21	0x6E95	I2 K-Factor	10-9999	×0.1	M_ME	R	
+22	0x6E96	I3 K-Factor	10-9999	×0.1	M_ME	R	
+23	0x6E97	I4 K-Factor	10-9999	×0.1	M_ME	R	
+24	0x6E98	V1 Crest Factor	0-10000	×0.01	M_ME	R	<sup>2</sup>
+25	0x6E99	V2 Crest Factor	0-10000	×0.01	M_ME	R	<sup>2</sup>
+26	0x6E9A	V3 Crest Factor	0-10000	×0.01	M_ME	R	<sup>2</sup>
+27	0x6E9B	V4 Crest Factor	0-10000	×0.01	M_ME	R	
+28	0x6E9C	I1 Crest Factor	0-10000	×0.01	M_ME	R	
+29	0x6E9D	I2 Crest Factor	0-10000	×0.01	M_ME	R	
+30	0x6E9E	I3 Crest Factor	0-10000	×0.01	M_ME	R	
+31	0x6E9F	I4 Crest Factor	0-10000	×0.01	M_ME	R	
44800-44831		<b>10-Minute Harmonics</b>					
+0	0x6F00	V1 THD	0-9999	×0.1%	M_ME	R	<sup>2</sup>
+1	0x6F01	V2 THD	0-9999	×0.1%	M_ME	R	<sup>2</sup>
+2	0x6F02	V3 THD	0-9999	×0.1%	M_ME	R	<sup>2</sup>
+3	0x6F03	V4 THD	0-9999	×0.1%	M_ME	R	
+4	0x6F04	I1 THD	0-9999	×0.1%	M_ME	R	
+5	0x6F05	I2 THD	0-9999	×0.1%	M_ME	R	
+6	0x6F06	I3 THD	0-9999	×0.1%	M_ME	R	
+7	0x6F07	I4 THD	0-9999	×0.1%	M_ME	R	
+8	0x6F08	V1 interharmonics THD	0-9999	×0.1%	M_ME	R	<sup>2</sup>
+9	0x6F09	V2 interharmonics THD	0-9999	×0.1%	M_ME	R	<sup>2</sup>
+10	0x6F0A	V3 interharmonics THD	0-9999	×0.1%	M_ME	R	<sup>2</sup>
+11	0x6F0B	V4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+12	0x6F0C	I1 interharmonics THD	0-9999	×0.1%	M_ME	R	
+13	0x6F0D	I2 interharmonics THD	0-9999	×0.1%	M_ME	R	
+14	0x6F0E	I3 interharmonics THD	0-9999	×0.1%	M_ME	R	
+15	0x6F0F	I4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+16	0x6F10	I1 TDD	0-1000	×0.1%	M_ME	R	
+17	0x6F11	I2 TDD	0-1000	×0.1%	M_ME	R	
+18	0x6F12	I3 TDD	0-1000	×0.1%	M_ME	R	
+19	0x6F13	I4 TDD	0-1000	×0.1%	M_ME	R	
+20	0x6F14	I1 K-Factor	10-9999	×0.1	M_ME	R	
+21	0x6F15	I2 K-Factor	10-9999	×0.1	M_ME	R	
+22	0x6F16	I3 K-Factor	10-9999	×0.1	M_ME	R	
+23	0x6F17	I4 K-Factor	10-9999	×0.1	M_ME	R	
+24	0x6F18	V1 Crest Factor	0-10000	×0.01	M_ME	R	<sup>2</sup>

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+25	0x6F19	V2 Crest Factor	0-10000	×0.01	M_ME	R	2
+26	0x6F1A	V3 Crest Factor	0-10000	×0.01	M_ME	R	2
+27	0x6F1B	V4 Crest Factor	0-10000	×0.01	M_ME	R	
+28	0x6F1C	I1 Crest Factor	0-10000	×0.01	M_ME	R	
+29	0x6F1D	I2 Crest Factor	0-10000	×0.01	M_ME	R	
+30	0x6F1E	I3 Crest Factor	0-10000	×0.01	M_ME	R	
+31	0x6F1F	I4 Crest Factor	0-10000	×0.01	M_ME	R	
44928-44959		<b>2-Hour Harmonics</b>					
+0	0x6F80	V1 THD	0-9999	×0.1%	M_ME	R	2
+1	0x6F81	V2 THD	0-9999	×0.1%	M_ME	R	2
+2	0x6F82	V3 THD	0-9999	×0.1%	M_ME	R	2
+3	0x6F83	V4 THD	0-9999	×0.1%	M_ME	R	
+4	0x6F84	I1 THD	0-9999	×0.1%	M_ME	R	
+5	0x6F85	I2 THD	0-9999	×0.1%	M_ME	R	
+6	0x6F86	I3 THD	0-9999	×0.1%	M_ME	R	
+7	0x6F87	I4 THD	0-9999	×0.1%	M_ME	R	
+8	0x6F88	V1 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+9	0x6F89	V2 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+10	0x6F8A	V3 interharmonics THD	0-9999	×0.1%	M_ME	R	2
+11	0x6F8B	V4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+12	0x6F8C	I1 interharmonics THD	0-9999	×0.1%	M_ME	R	
+13	0x6F8D	I2 interharmonics THD	0-9999	×0.1%	M_ME	R	
+14	0x6F8E	I3 interharmonics THD	0-9999	×0.1%	M_ME	R	
+15	0x6F8F	I4 interharmonics THD	0-9999	×0.1%	M_ME	R	
+16	0x6F90	I1 TDD	0-1000	×0.1%	M_ME	R	
+17	0x6F91	I2 TDD	0-1000	×0.1%	M_ME	R	
+18	0x6F92	I3 TDD	0-1000	×0.1%	M_ME	R	
+19	0x6F93	I4 TDD	0-1000	×0.1%	M_ME	R	
+20	0x6F94	I1 K-Factor	10-9999	×0.1	M_ME	R	
+21	0x6F95	I2 K-Factor	10-9999	×0.1	M_ME	R	
+22	0x6F96	I3 K-Factor	10-9999	×0.1	M_ME	R	
+23	0x6F97	I4 K-Factor	10-9999	×0.1	M_ME	R	
+24	0x6F98	V1 Crest Factor	0-10000	×0.01	M_ME	R	2
+25	0x6F99	V2 Crest Factor	0-10000	×0.01	M_ME	R	2
+26	0x6F9A	V3 Crest Factor	0-10000	×0.01	M_ME	R	2
+27	0x6F9B	V4 Crest Factor	0-10000	×0.01	M_ME	R	
+28	0x6F9C	I1 Crest Factor	0-10000	×0.01	M_ME	R	
+29	0x6F9D	I2 Crest Factor	0-10000	×0.01	M_ME	R	
+30	0x6F9E	I3 Crest Factor	0-10000	×0.01	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+31	0x6F9F	I4 Crest Factor	0-10000	×0.01	M_ME	R	
47104-47143		<b>Present PQ Measurements (EN50160)</b>					
+0	0x7800	V1 Voltage variation, +/-%Un		0.01%	M_ME	R	Last 10 min measurement
+1	0x7801	V2 Voltage variation, +/-%Un		0.01%	M_ME	R	"
+2	0x7802	V3 Voltage variation, +/-%Un		0.01%	M_ME	R	"
+3	0x7803	Not used				R	"
+4	0x7804	V1 Voltage change, %Un		0.01%	M_ME	R	Last 1 hour measurement
+5	0x7805	Repetition rate of V1 voltage changes, 1/min		1/min × 0.01	M_ME	R	"
+6	0x7806	V2 Voltage change, %Un		0.01%	M_ME	R	"
+7	0x7807	Repetition rate of V2 voltage changes, 1/min		1/min × 0.01	M_ME	R	"
+8	0x7808	V3 Voltage change, %Un		0.01%	M_ME	R	"
+9	0x7809	Repetition rate of V3 voltage changes, 1/min		1/min × 0.01	M_ME	R	"
+10	0x780A	V1 Voltage Pst		0.01	M_ME	R	Last 10 min measurement
+11	0x780B	V2 Voltage Pst		0.01	M_ME	R	"
+12	0x780C	V3 Voltage Pst		0.01	M_ME	R	"
+13	0x780D	V1 Voltage Plt		0.01	M_ME	R	Last 2 hour measurement
+14	0x780E	V2 Voltage Plt		0.01	M_ME	R	"
+15	0x780F	V3 Voltage Plt		0.01	M_ME	R	"
+16	0x7810	V1 Voltage THD, %		0.1%	M_ME	R	Last 10 min measurement
+17	0x7811	V2 Voltage THD, %		0.1%	M_ME	R	"
+18	0x7812	V3 Voltage THD, %		0.1%	M_ME	R	"
+19	0x7813	Negative-sequence voltage unbalance, %		0.1%	M_ME	R	"
+20	0x7814	Not used				R	"
+21	0x7815	Frequency variation, +/-Hz		0.01 Hz	M_ME	R	Last 10 s measurement
+22	0x7816	Voltage interruption, residual voltage A/AB, %Un		0.01%	M_ME	R	
+23	0x7817	Voltage interruption, residual voltage B/BC, %Un		0.01%	M_ME	R	
+24	0x7818	Voltage interruption, residual voltage C/CA, %Un		0.01%	M_ME	R	
+25	0x7819	Duration of a polyphase interruption		ms	M_ME	R	
+26	0x781A	Voltage dip, residual voltage oh phase A/AB, %Un		0.01%	M_ME	R	
+27	0x781B	Voltage dip, residual voltage on phase B/BC, %Un		0.01%	M_ME	R	
+28	0x781C	Voltage dip, residual voltage on phase C/CA, %Un		0.01%	M_ME	R	
+29	0x781D	Voltage dip, duration of a polyphase dip		ms	M_ME	R	
+30	0x781E	Voltage swell, voltage magnitude on phase A/AB, %Un		0.01%	M_ME	R	
+31	0x781F	Voltage swell, voltage magnitude on phase B/BC, %Un		0.01%	M_ME	R	
+32	0x7820	Voltage swell, voltage magnitude on phase C/CA, %Un		0.01%	M_ME	R	
+33	0x7821	Voltage swell, duration of a polyphase swell		ms	M_ME	R	
+34	0x7822	Impulsive voltage on phase A/AB, %Un peak		0.01%	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+35	0x7823	Impulsive voltage, impulse duration on phase A/AB		us	M_ME	R	
+36	0x7824	Impulsive voltage on phase B/BC, %Un peak		0.01%	M_ME	R	
+37	0x7825	Impulsive voltage, impulse duration on phase B/BC		us	M_ME	R	
+38	0x7826	Impulsive voltage on phase C/CA, %Un peak		0.01%	M_ME	R	
+39	0x7827	Impulsive voltage, impulse duration on phase C/CA		us	M_ME	R	
47104-47143	<b>Present PQ Measurements (GOST 13109)</b>						
+0	0x7800	Voltage variation ( $\delta U_y$ ) on phase A/AB, +/-%Un		0.01%	M_ME	R	Last 1 min measurement
+1	0x7801	Voltage variation ( $\delta U_y$ ) on phase B/BC, +/-%Un		0.01%	M_ME	R	"
+2	0x7802	Voltage variation ( $\delta U_y$ ) on phase C/CA, +/-%Un		0.01%	M_ME	R	"
+3	0x7803	Positive sequence voltage variation ( $\delta U_y$ ), +/-%Un		0.01%	M_ME	R	"
+4	0x7804	Voltage change ( $\delta U_t$ ) on phase A/AB, %Un		0.01%	M_ME	R	Last 10 min measurement
+5	0x7805	Repetition rate of voltage changes ( $F\delta U_t$ ) A/AB, 1/min		1/min × 0.01	M_ME	R	"
+6	0x7806	Voltage change ( $\delta U_t$ ) on phase B/BC, %Un		0.01%	M_ME	R	"
+7	0x7807	Repetition rate of voltage changes ( $F\delta U_t$ ) B/BC, 1/min		1/min × 0.01	M_ME	R	"
+8	0x7808	Voltage change ( $\delta U_t$ ) on phase C/CA, %Un		0.01%	M_ME	R	"
+9	0x7809	Repetition rate of voltage changes ( $F\delta U_t$ ) C/CA, 1/min		1/min × 0.01	M_ME	R	"
+10	0x780A	Voltage Pst on phase A/AB		0.01	M_ME	R	Last 10 min measurement
+11	0x780B	Voltage Pst on phase B/BC		0.01	M_ME	R	"
+12	0x780C	Voltage Pst on phase C/CA		0.01	M_ME	R	"
+13	0x780D	Voltage Plt on phase A/AB		0.01	M_ME	R	Last 2 hour measurement
+14	0x780E	Voltage Plt on phase B/BC		0.01	M_ME	R	"
+15	0x780F	Voltage Plt on phase C/CA		0.01	M_ME	R	"
+16	0x7810	Voltage THD (KU) on phase A/AB, %		0.1%	M_ME	R	Last 3 s measurement
+17	0x7811	Voltage THD (KU) on phase B/BC, %		0.1%	M_ME	R	"
+18	0x7812	Voltage THD (KU) on phase C/CA, %		0.1%	M_ME	R	"
+19	0x7813	Negative-sequence voltage unbalance (K2u), %		0.1%	M_ME	R	"
+20	0x7814	Zero-sequence voltage unbalance (K0u), %		0.1%	M_ME	R	"
+21	0x7815	Frequency variation ( $\Delta f$ ), +/-Hz		0.01 Hz	M_ME	R	Last 20 s measurement
+22	0x7816	Not used				R	
+23	0x7817	Not used				R	
+24	0x7818	Not used				R	
+25	0x7819	Not used				R	
+26	0x781A	Voltage dip, dip depth on phase A/AB, %Un		0.01%	M_ME	R	
+27	0x781B	Voltage dip, dip depth on phase B/BC, %Un		0.01%	M_ME	R	
+28	0x781C	Voltage dip, dip depth on phase C/CA, %Un		0.01%	M_ME	R	
+29	0x781D	Voltage dip, duration of a polyphase dip		ms	M_ME	R	
+30	0x781E	Overvoltage, voltage magnitude on phase A/AB, %Un		0.01%	M_ME	R	
+31	0x781F	Overvoltage, voltage magnitude on phase B/BC, %Un		0.01%	M_ME	R	
+32	0x7820	Overvoltage, voltage magnitude on phase C/CA, %Un		0.01%	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+33	0x7821	Overtoltage, duration of a polyphase overvoltage		ms	M_ME	R	
+34	0x7822	Impulsive voltage on phase A/AB, %Un peak		0.01%	M_ME	R	
+35	0x7823	Impulsive voltage, impulse duration on phase A/AB		us	M_ME	R	
+36	0x7824	Impulsive voltage on phase B/BC, %Un peak		0.01%	M_ME	R	
+37	0x7825	Impulsive voltage, impulse duration on phase B/BC		us	M_ME	R	
+38	0x7826	Impulsive voltage on phase C/CA, %Un peak		0.01%	M_ME	R	
+39	0x7827	Impulsive voltage, impulse duration on phase C/CA		us	M_ME	R	
47104-47143		<b>Present PQ Measurements (GOST 54149)</b>					
+0	0x7800	Voltage variation ( $\delta U_y$ ) on phase A/AB, +/-%Un		0.01%	M_ME	R	Last 10 min measurement
+1	0x7801	Voltage variation ( $\delta U_y$ ) on phase B/BC, +/-%Un		0.01%	M_ME	R	"
+2	0x7802	Voltage variation ( $\delta U_y$ ) on phase C/CA, +/-%Un		0.01%	M_ME	R	"
+3	0x7803	Not used				R	"
+4	0x7804	Voltage change ( $\delta U_t$ ) on phase A/AB, %Un		0.01%	M_ME	R	Last 1-60 min measurement
+5	0x7805	Not used				R	"
+6	0x7806	Voltage change ( $\delta U_t$ ) on phase B/BC, %Un		0.01%	M_ME	R	"
+7	0x7807	Not used				R	"
+8	0x7808	Voltage change ( $\delta U_t$ ) on phase C/CA, %Un		0.01%	M_ME	R	"
+9	0x7809	Not used				R	"
+10	0x780A	Voltage Pst on phase A/AB		0.01	M_ME	R	Last 10 min measurement
+11	0x780B	Voltage Pst on phase B/BC		0.01	M_ME	R	"
+12	0x780C	Voltage Pst on phase C/CA		0.01	M_ME	R	"
+13	0x780D	Voltage Plt on phase A/AB		0.01	M_ME	R	Last 2 hour measurement
+14	0x780E	Voltage Plt on phase B/BC		0.01	M_ME	R	"
+15	0x780F	Voltage Plt on phase C/CA		0.01	M_ME	R	"
+16	0x7810	Voltage THD (KU) on phase A/AB, %		0.1%	M_ME	R	Last 10 min measurement
+17	0x7811	Voltage THD (KU) on phase B/BC, %		0.1%	M_ME	R	"
+18	0x7812	Voltage THD (KU) on phase C/CA, %		0.1%	M_ME	R	"
+19	0x7813	Negative-sequence voltage unbalance (K2u), %		0.1%	M_ME	R	"
+20	0x7814	Zero-sequence voltage unbalance (K0u), %		0.1%	M_ME	R	"
+21	0x7815	Frequency variation ( $\Delta f$ ), +/-Hz		0.01 Hz	M_ME	R	Last 10 s measurement
+22	0x7816	Voltage interruption, residual voltage A/AB, %Un		0.01%	M_ME	R	
+23	0x7817	Voltage interruption, residual voltage B/BC, %Un		0.01%	M_ME	R	
+24	0x7818	Voltage interruption, residual voltage C/CA, %Un		0.01%	M_ME	R	
+25	0x7819	Duration of a polyphase interruption		ms	M_ME	R	
+26	0x781A	Voltage dip, residual voltage oh phase A/AB, %Un		0.01%	M_ME	R	
+27	0x781B	Voltage dip, residual voltage on phase B/BC, %Un		0.01%	M_ME	R	
+28	0x781C	Voltage dip, residual voltage on phase C/CA, %Un		0.01%	M_ME	R	
+29	0x781D	Voltage dip, duration of a polyphase dip		ms	M_ME	R	
+30	0x781E	Voltage swell, voltage magnitude on phase A/AB, %Un		0.01%	M_ME	R	

IO Address	Point ID	Description	Measurement Range <sup>2</sup>	Units and Resolution <sup>2</sup>	Type <sup>4</sup>	R/W	Notes
+31	0x781F	Voltage swell, voltage magnitude on phase B/BC, %Un		0.01%	M_ME	R	
+32	0x7820	Voltage swell, voltage magnitude on phase C/CA, %Un		0.01%	M_ME	R	
+33	0x7821	Voltage swell, duration of a polyphase swell		ms	M_ME	R	
+34	0x7822	Impulsive voltage on phase A/AB, %Un peak		0.01%	M_ME	R	
+35	0x7823	Impulsive voltage, impulse duration on phase A/AB		us	M_ME	R	
+36	0x7824	Impulsive voltage on phase B/BC, %Un peak		0.01%	M_ME	R	
+37	0x7825	Impulsive voltage, impulse duration on phase B/BC		us	M_ME	R	
+38	0x7826	Impulsive voltage on phase C/CA, %Un peak		0.01%	M_ME	R	
+39	0x7827	Impulsive voltage, impulse duration on phase C/CA		us	M_ME	R	

**NOTES:**

- 1 When the 4LN3, 4LL3, 3LN3, 3LL3, 3BLN3 or 3BLL3 wiring mode is selected, the voltages will be line-to-neutral; for any other wiring mode, they will be line-to-line.
- 2 When the 4LN3, 3LN3 or 3BLN3 wiring mode is selected, the voltages will be line-to-neutral; for any other wiring mode, they will be line-to-line voltages.
- 3 For volts, amps, power and frequency scales and units, refer to Section 4 "Data Scales and Units".
- 4 On a 0.2-s interval (16-cycle GOST 13109).
- 5 On a 3-s interval.
- 6 Harmonic angles are referenced to the fundamental voltage harmonic H01 on phase L1.

### 3.2.4 Integrated Totals

IO Address	Point ID	Description	Measurement Range <sup>1</sup>	Units and Resolution <sup>1</sup>	Type <sup>2</sup>	R/W	Notes
18944-18975		<b>Counters</b>					
	+0	Counter #1	0-999,999,999		M_IT, C_CI	R/W	
	+1	Counter #2	0-999,999,999		M_IT, C_CI	R/W	
		...					
	+31	Counter #32	0-999,999,999		M_IT, C_CI	R/W	
22272-22293		<b>Total Energies</b>					
	+0	kWh import	0-999,999,999	U5	M_IT, C_CI	R	
	+1	kWh export	0-999,999,999	U5	M_IT, C_CI	R	
	+2	kWh net	-999,999,999-999,999,999	U5	M_IT, C_CI	R	
	+3	kWh total	0-999,999,999	U5	M_IT, C_CI	R	
	+4	kvarh import	0-999,999,999	U5	M_IT, C_CI	R	

<b>IO Address</b>	<b>Point ID</b>	<b>Description</b>	<b>Measurement Range <sup>1</sup></b>	<b>Units and Resolution <sup>1</sup></b>	<b>Type <sup>2</sup></b>	<b>R/W</b>	<b>Notes</b>
+5	0x1705	kvarh export	0-999,999,999	U5	M_IT, C_CI	R	
+6	0x1706	kvarh net	-999,999,999-999,999,999	U5	M_IT, C_CI	R	
+7	0x1707	kvarh total	0-999,999,999	U5	M_IT, C_CI	R	
+8	0x1708	kVAh total	0-999,999,999	U5	M_IT, C_CI	R	
+9	0x1709	Vh total	0-999,999,999	1 Vh	M_IT, C_CI	R	
+10	0x170A	Ah total	0-999,999,999	1 Ah	M_IT, C_CI	R	
+11	0x170B	kVAh import	0-999,999,999	U5	M_IT, C_CI	R	
+12	0x170C	kVAh export	0-999,999,999	U5	M_IT, C_CI	R	
+13	0x170D	Not used			M_IT, C_CI	R	
+14	0x170E	Not used			M_IT, C_CI	R	
+15	0x170F	Not used			M_IT, C_CI	R	
+16	0x1710	Not used			M_IT, C_CI	R	
+17	0x1711	Not used			M_IT, C_CI	R	
+18	0x1712	kvarh Q1	0-999,999,999	U5	M_IT, C_CI	R	
+19	0x1713	kvarh Q2	0-999,999,999	U5	M_IT, C_CI	R	
+20	0x1714	kvarh Q3	0-999,999,999	U5	M_IT, C_CI	R	
+21	0x1715	kvarh Q4	0-999,999,999	U5	M_IT, C_CI	R	
22400-22415		<b>Billing Summary Registers</b>					
+0	0x1780	Summary energy register #1	0-999,999,999	U5	M_IT, C_CI	R	
+1	0x1781	Summary energy register #2	0-999,999,999	U5	M_IT, C_CI	R	
		...					
+15	0x178F	Summary energy register #16	0-999,999,999	U5	M_IT, C_CI	R	
32000-32015		<b>Billing TOU Register #1</b>					
+0	0x3D00	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
+1	0x3D01	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
+15	0x3D0F	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
32256-32271		<b>Billing TOU Register #2</b>					
+0	0x3E00	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
+1	0x3E01	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
+15	0x3E0F	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
32512-32527		<b>Billing TOU Register #3</b>					
+0	0x3F00	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
+1	0x3F01	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
+15	0x3F0F	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
32768-32783		<b>Billing TOU Register #4</b>					
+0	0x4000	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	

IO Address	Point ID	Description	Measurement Range <sup>1</sup>	Units and Resolution <sup>1</sup>	Type <sup>2</sup>	R/W	Notes
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
33024-33039		<b>Billing TOU Register #5</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
33280-33295		<b>Billing TOU Register #6</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
33536-33551		<b>Billing TOU Register #7</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...				R	
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
33792-33807		<b>Billing TOU Register #8</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
35584-35599		<b>Billing TOU Register #9</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
35840-35855		<b>Billing TOU Register #10</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
36096-36101		<b>Billing TOU Register #11</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	

IO Address	Point ID	Description	Measurement Range <sup>1</sup>	Units and Resolution <sup>1</sup>	Type <sup>2</sup>	R/W	Notes
36352-36367		<b>Billing TOU Register #12</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
36608-36623		<b>Billing TOU Register #13</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
36864-36879		<b>Billing TOU Register #14</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
37120-37135		<b>Billing TOU Register #15</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	
37376-37391		<b>Billing TOU Register #16</b>					
	+0	Tariff #1 register	0-999,999,999	U5	M_IT, C_CI	R	
	+1	Tariff #2 register	0-999,999,999	U5	M_IT, C_CI	R	
		...					
	+15	Tariff #16 register	0-999,999,999	U5	M_IT, C_CI	R	

**NOTES:**

<sup>1</sup> For volts, amps, power and frequency measurement range, resolution and scale factors refer to Section 4 "Data Scales and Units".

<sup>2</sup> Object types: M\_ME – measured value, M\_SP – single point information, M\_DP – double point information, M\_IT – integrated total (counter), C\_SC – single command, C\_CI – counter interrogation command. See F3 through F10 in Section 5 for compatible object types.

### 3.3 Device Status and Control Parameters

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
<b>Device Port Identification</b>							
6144		Active serial port number	0-2 = serial port COM1-COM3, 3 = IR Port, 4 = Modem port, 5 = USB/Modbus port, 6-10 = Ethernet/TCP port		P_ME_NB_1	R	
<b>Device Diagnostics</b>							
6145		Internal device diagnostics (bits 0:15). Read: bits set to 1 indicate diagnostics failed at least once since last reset. Write: preset bits to 0 to clear corresponding diagnostics flags; bits set to 1 have no effect.	F2		P_ME_NB_1	R/W	
6146		Internal device diagnostics (bits 16:32). Not used	0		P_ME_NB_1	R/W	
<b>Reference Meter Time</b>							
6175		Scaled zero value followed by a meter clock time For example [6175: 0 Q00 t 24.03.2015 15:48:50:524]	0		M_ME_TE_1	R	
<b>Device Reset/Clear Registers</b>							
6176-6186					P_ME_NB_1		
6176		Clear energy registers	0			W	
6177		Clear maximum demand	0 = clear all maximum demands 1 = clear power demands 2 = clear volt and ampere demands 3 = clear volt demands 4 = clear ampere demands 5 = clear harmonic demands			W	
6178		Clear billing/TOU energy registers	0			W	
6179		Clear billing/TOU maximum demand registers	0			W	
6180		Clear pulse counters	0 = Clear all counters 1-4 = Clear counter #1-#32			W	
6181		Clear Min/Max log	0			W	
6182		Clear operation/event counters	0 = clear EN50160/GOST 13109/GOST 54149 statistics 6 = clear communication counters 7 = clear switch operation counters			W	
<b>Device Authorization Register</b>							
6208-6209		Read: 0 = access permitted, -1 = authorization required.	0 - 99999999 (write) 0/-1 (read)		P_ME_NB_1 UI32	R/W	

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
		Write: 8-digit password.					

### 3.4 System Parameters

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
<b>Device Identification</b>							
4224-4255				P_ME_NB_1			
+0,1	Device serial number	0-99999999		UI32	R		
+2,3	Device model ID	13030		UI32	R		
+4-11	Device model name	"PM180"		OS128ASCII	R		Null-terminated octet string
+12-13	Device options (bitmap)	0		UI32	R		
+14-19	Reserved				R		
+20	Device firmware version number	3101-3199			R		Two higher decimal digits = major version number, two lower decimal digits = minor version number
+21	Device firmware build number	1-99			R		
+22	Transient recorder firmware version number	3201-3299			R		
+23	Transient recorder firmware build number	1-99			R		
+24	Boot loader version number				R		
+25	Boot loader build number				R		
+26-31	Reserved				R		
<b>Factory Device Settings</b>							
4256-4322				P_ME_NB_1			
+0	V1-V3 input range	690	V		R		
+1	V1-V3 input overload	120	%		R		
+2	V4 input range	690	V		R		
+3	V4 input overload	120	%		R		
+4	I1-I3 input range	1, 5	A		R		
+5	I1-I3 input overload	400 (ANSI), 200 (IEC)	%		R		
+6	I4 input range	1, 5	A		R		
+7	I4 input overload	400 (ANSI), 200 (IEC)	%		R		
+8	I1x-I3x input range	1, 5	A		R		
+9	I1x-I3x input overload	2000	%		R		
+10	I4x input range	1, 5	A		R		
+11	I4x input overload	2000	%		R		
+12-63	Reserved				R		
+64-66	Ethernet MAC address	0x0005F0000000-0x0005F000FFFF		OS48	R		

### 3.5 Device Setup Parameters

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
<b>Communication Ports Setup Parameters</b>							
4096-4127				P_ME_NB_1			
+0		Communication protocol	0 = Modbus RTU, 1 = Modbus ASCII, 2 = DNP3.0, 7=IEC 60870-5			R/W	
+1		Interface	0 = RS-232, 1 = RS-422, 2 = RS-485, 3 = Infrared, 4 = Modem			R/W	
+2		Device address	Modbus: 1-247 DNP3.0: 0-65532 IEC 60870-5: 1-254 (1 octet), 1-65532 (2 octets)			R/W	
+3		Baud rate	1 = 300 bps, 2 = 600 bps, 3 = 1200 bps, 4 = 2400 bps, 5 = 4800 bps, 6 = 9600 bps, 7 = 19200 bps, 8 = 38400 bps, 9 = 57600 bps, 10 = 115200 bps			R/W	
+4		Data format	0 = 7 bits/even parity, 1 = 8 bits/no parity, 2 = 8 bits/odd parity			R/W	
+5		CTS mode	0 = not used, 1 = wait for CTS before sending data			R/W	N/A for COM2-COM5 (read as 65535)
+6		RTS mode	0 = not used, 1 = RTS is asserted during the transmission			R/W	N/A for COM2-COM5 (read as 65535)
+7		Minimum delay before sending data	0-1000 (default = 5)			R/W	
+8		Inter-character timeout	1-1000 (default = 4)				Added to standard 4-character time
+9-15		Reserved				R/W	
4096-4111		<b>COM1 Setup</b>					
4112-4127		<b>COM2 Setup</b>					Only 8 bits/no parity data format
4128-4143		<b>COM3 Setup</b>					
4144-4159		<b>COM4 Setup</b>					
4160-4175		<b>COM5 Setup</b>					
<b>Basic Device Setup Parameters</b>							
4352-4372				P_ME_NC_1			
+0		Wiring mode	F1			R/W	
+1		PT ratio (primary to secondary ratio)	10-65000	×0.1		R/W	
+2		PT secondary (Line-to-Line)	500-7000	×0.1		R/W	
+3		V4 PT ratio (primary to secondary ratio)	10-65000	×0.1		R/W	
+4		V4 PT secondary voltage	500-7000	×0.1		R/W	

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
+5		CT primary current	1-30000	A		R/W	
+6		Reserved				R/W	
+7		I4 CT primary current	1-30000	A		R/W	
+8-16		Reserved				R/W	
+17		Nominal line frequency	50, 60	Hz		R/W	
+18		Phase order	0 = ABC, 1 = CBA			R/W	
+19-23		Reserved				R/W	
+24		I maximum demand load current	0-30000	A		R/W	
+25		I4 maximum demand load current	0-30000	A		R/W	
+26-31		Reserved				R/W	

#### Device Options Setup

4384-4398				P_ME_NC_1		
+0		Power calculation mode	0 = using reactive power: $S = f(P,Q)$ , 1 = using non-active power: $Q = f(S,P)$		R/W	
+1		Energy roll value	$0 = 1 \times 10^4, 1 = 1 \times 10^5, 2 = 1 \times 10^6, 3 = 1 \times 10^7, 4 = 1 \times 10^8, 5 = 1 \times 10^9$		R/W	
+2		Number of energy decimal places	0-3		R/W	Default 0
+3		Reserved			R/W	
+4		Tariff control	0 = via a calendar scheduler, 0x4000 = via communications, 0x0100-0x010F = via tariff inputs DI1-DI16 (bits 0:3 denote the first digital input index used)		R/W	
+5		Number of tariffs	1-16 (does not have effect with a calendar tariff control option)		R/W	When read with a calendar tariff control option, indicates the actual number of tariffs selected in TOU profiles
+6		Reserved			R/W	
+7		Energy LED test mode	0=disabled, 1=Wh test, 2=varh test		R/W	
+8		Test energy LED pulse rate, Wh/varh per pulse (in secondary units)	1-40	×0.01		

#### Device Data Scales

4418-4419				P_ME_NC_1		
+0		Voltage scale, secondary volts	60-828	1V	R/W	Default 144V
+1		Current scale, secondary amps	10-100	×0.1A	R/W	Default 2×CT secondary

## 3.6 Protocol Setup Parameters

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
<b>IEC 60870-5 Options Setup</b>							
4480-4514					P_ME_NB_1		
+0		Maximum length of variable frame, octets	32-255			R/W	Fixed to 253 in IEC 60870-5-104
+1		Link address length, octets	1-2			R/W	Not used in IEC 60870-5-104
+2		Cause of transmission length, octets	1-2			R/W	Fixed to 2 in IEC 60870-5-104
+3		Length of common address of ASDU, octets	1-2			R/W	Fixed to 2 in IEC 60870-5-104
+4		Length of information object address, octets	1-3			R/W	Fixed to 3 in IEC 60870-5-104
+5		Select-before-operate timeout, s	0-30			R/W	
+6		Short pulse duration, ms	100-3000	ms		R/W	
+7		Long pulse duration, ms	100-3000	ms		R/W	
+8,9		Time synchronization period, s	1-86400, 0=not active	s	UI32	R/W	
+10		Local counter freeze period, min	1-60, 0=not active	min		R/W	
+11		Cyclic data transmission period, ms	100-30000, 0=not active	ms		R/W	Effective in IEC 60870-5-104 only
+12,13		Redundant connection IP address #1	0-0xFFFFFE, 0=not active		UI32	R/W	
+14,15		Redundant connection IP address #2	0-0xFFFFFE, 0=not active		UI32	R/W	
+16,17		Not used	0		UI32	R/W	
+18		Not used	0			R/W	
+19		Respond with class 1 data to class 2 requests	0=disabled, 1=enabled			R/W	
+20		Single point start mapped address	1-4095			R/W	
+21		Single point default static object type	F3			R/W	
+22		Single point default event object type	F4			R/W	
+23		Double point start mapped address	1-4095			R/W	
+24		Double point default static object type	F5			R/W	
+25		Double point default event object type	F6			R/W	
+26		Measured value start mapped address	1-4095			R/W	
+27		Measured value default static object type	F7			R/W	
+28		Measured value default event object type	F8			R/W	
+29		Integrated totals start mapped address	1-4095			R/W	
+30		Integrated totals default static object type	F9			R/W	
+31		Integrated totals default event object type	F10			R/W	
+32		Voltage units	0=V, 1=kV			R/W	
+33		Current units	0=A, 1=kA			R/W	
+34		Power units	0=kW, 1=MW			R/W	
<b>IEC 60870-5 Class 2 Data and Counters Setup</b>							
4544-4639					P_ME_NB_1		

IO Address	Point ID	Description	Options/Range	Units and Resolution	Type	R/W	Notes
	+0	Information object type and flags	Bits 0:7 – static object type identification (F3, F5, F7, F9), Bit 8=1 – freeze with reset, Bit 9=1 – local freeze, Bit 10=1 – cyclic data transmission, Bit 11=1 – general interrogation, Bits 12:15 – interrogation group = 0-15 (0=no group assigned)			R/W	See Section 3.2 for compatible object types.
	+1	Start information object address	1-65535			R/W	
	+2	Number of elements in the range	1-128			R/W	
4544-4546		<b>Object address range #1</b>					
4547-4549		<b>Object address range #2</b>					
...		...					
4637-4639		<b>Object address range #32</b>					
<b>IEC 60870-5 Assignable Point Map and Events Setup</b>							
4736-4927				P_ME_NB_1			
	+0	Point ID	See Section 3.2			R/W	
	+1	Information object type and flags	Bits 0:7 – static object type identification (F3, F5, F7), Bits 8:9 – relation (0=delta, 1= more than, 2 = less than) Bit 10=1 – class 1 assignment			R/W	See Section 3.2 for compatible object types.
	+2	Deadband/threshold	See Section 3.2 for the point range and resolution			R/W	
4736-4738		<b>Mapped static/event point #1</b>					
4739-4741		<b>Mapped static/event point #2</b>					
...		...					
4625-4927		<b>Mapped static/event point #64</b>					

## 4 Data Scales and Units

Code	Condition	Value/Range	Notes
<b>Data Scales</b>			
Vmax		Voltage Scale $\times$ PT Ratio, V	2
V4max		Voltage Scale $\times$ V4 PT Ratio, V	2
Imax		Current Scale $\times$ CT Ratio <sup>1</sup> , A,	3
I4max		Current Scale $\times$ I4 CT Ratio <sup>1</sup> , A,	3
Ixmax	1A secondary	20 $\times$ CT Ratio <sup>1</sup> , A (CT card) 40 $\times$ CT Ratio <sup>1</sup> , A (DFRM)	
	5A secondary	100 $\times$ CT Ratio <sup>1</sup> , A (CT card) 200 $\times$ CT Ratio <sup>1</sup> , A (DFRM)	
I4xmax	1A secondary	20 $\times$ I4x CT Ratio <sup>1</sup> , A (CT card) 40 $\times$ I4x CT Ratio <sup>1</sup> , A (DFRM)	
	5A secondary	100 $\times$ I4x CT Ratio <sup>1</sup> , A (CT card) 200 $\times$ I4x CT Ratio <sup>1</sup> , A (DFRM)	
Pmax	PT Ratio = 1	Vmax $\times$ Imax $\times$ 2, W	4
	PT Ratio > 1	(Vmax $\times$ Imax $\times$ 2)/1000, kW	
AImin AImax	+/-1mA	AImin = -AI full scale $\times$ 2 AImax = AI full scale $\times$ 2	
	0-20mA	AImin = AI zero scale AImax = AI full scale	
	4-20mA	AImin = AI zero scale AImax = AI full scale	
	0-1mA	AImin = AI zero scale AImax = AI full scale	
	0-50mA	AImin = AI zero scale AImax = AI full scale $\times$ 2	
	+/-10V	AImin = -AI full scale AImax = AI full scale	
<b>Data Units</b>			
U1	PT Ratio = 1	0.1V	
	PT Ratio > 1	1V	
U2		0.01A	
U3	PT Ratio = 1	1W/Var/VA	
	PT Ratio > 1	1kW/kvar/kVA	
U4	V4 PT Ratio = 1	0.1V	
	V4 PT Ratio > 1	1V	
U5		0.001, 0.01, 0.1, 1 kWh/kVAh/kvarh (programmable)	5

<sup>1</sup> CT Ratio = CT primary current/CT secondary current

<sup>2</sup> The default Voltage Scale is 828V. <sup>3</sup> The default Current Scale is 4  $\times$  CT secondary current for devices with a 400% overload (ANSI) or 2  $\times$  CT secondary current for devices with a 200% overload (IEC).

<sup>4</sup> Pmax is rounded to whole kilowatts. If Pmax is greater than 9,999,000 W, it is truncated to 9,999,000 W.

<sup>5</sup> See Energy Decimal Places in the Device Options setup.

## 5 Data Formats

Format Code	Value	Description	Notes
<b>Wiring Mode</b>			
F1	0	3OP2 - 3-wire open delta using 2 CTs (2 element)	
	1	4LN3 - 4-wire WYE using 3 PTs (3 element), line-to-neutral voltage readings	
	2	3DIR2 - 3-wire direct connection using 2 CTs (2 element)	
	3	4LL3 - 4-wire WYE using 3 PTs (3 element), line-to-line voltage readings	
	4	3OP3 - 3-wire open delta using 3 CTs (2 1/2 element)	
	5	3LN3 - 4-wire WYE using 2 PTs (2 1/2 element), line-to-neutral voltage readings	
	6	3LL3 - 4-wire WYE using 2 PTs (2 1/2 element), line-to-line voltage readings	
	8	3BLN3 - 3-wire broken delta using 2 PTs (2 1/2 element), line-to-neutral voltage readings	
	9	3BLL3 - 3-wire broken delta using 2 PTs (2 1/2 element), line-to-line voltage readings	
<b>Device Diagnostics</b>			
F2	Bit 0	Reserved	
	Bit 1	Reserved	
	Bit 2 = 1	RAM/Data error	
	Bit 3 = 1	CPU watchdog reset	
	Bit 4 = 1	Sampling fault	
	Bit 5 = 1	CPU exception	
	Bit 6	Reserved	
	Bit 7 = 1	Software watchdog reset	
	Bit 8 = 1	Power down	
	Bit 9 = 1	Device reset	
	Bit 10 = 1	Configuration reset	
	Bit 11 = 1	RTC fault	
	Bit 12	Reserved	
	Bit 13	Reserved	
	Bit 14	Reserved	
	Bit 15 = 1	EEPROM fault	
<b>Single Point Info Static Type</b>			
F3	1	M_SP_NA_1	
	2	M_SP_TA_1 (CP24Time2a)	
	30	M_SP_TB_1 (CP56Time2a)	
<b>Single Point Info Event Type</b>			
F4	2	M_SP_TA_1 (CP24Time2a)	
	30	M_SP_TB_1 (CP56Time2a)	
<b>Double Point Info Static Type</b>			
F5	3	M_DP_NA_1	
	4	M_DP_TA_1 (CP24Time2a)	
	31	M_DP_TB_1 (CP56Time2a)	
<b>Double Point Info Event Type</b>			
F6	4	M_DP_TA_1 (CP24Time2a)	
	31	M_DP_TB_1 (CP56Time2a)	
<b>Measured Value Static Type</b>			
F7	9	M_ME_NA_1	
	10	M_ME_NB_1	
	11	M_ME_NC_1	
	12	M_ME_TA_1 (CP24Time2a)	
	13	M_ME_TB_1 (CP24Time2a)	
	14	M_ME_TC_1 (CP24Time2a)	
	34	M_ME_TD_1 (CP56Time2a)	
	35	M_ME_TE_1 (CP56Time2a)	
	36	M_ME_TF_1 (CP56Time2a)	
<b>Measured Value Event Type</b>			
F8	12	M_ME_TA_1 (CP24Time2a)	
	13	M_ME_TB_1 (CP24Time2a)	
	14	M_ME_TC_1 (CP24Time2a)	
	34	M_ME_TD_1 (CP56Time2a)	
	35	M_ME_TE_1 (CP56Time2a)	

<b>Format Code</b>	<b>Value</b>	<b>Description</b>	<b>Notes</b>
	36	M_ME_TF_1 (CP56Time2a)	
<b>Integrated Totals Static Type</b>			
F9	15	M_IT_NA_1	
	16	M_IT_TA_1 (CP24Time2a)	
	37	M_IT_TB_1 (CP56Time2a)	
<b>Integrated Totals Event Type</b>			
F10	16	M_IT_TA_1 (CP24Time2a)	
	37	M_IT_TB_1 (CP56Time2a)	

# 6 Configuring IEC 60870-5

Use the PAS software provided with your meter to configure IEC 60870-5 options. See the PM180 Installation and Operation Manual for more information on installation and operating PAS on your computer.

Configuring IEC 60870-5 is available via both Modbus and IEC 60870-5 ports.


NOTE:

PAS supports only client connections with the meters via TCP ports. To avoid loss of communications via a TCP/IP connection, do not allow sending spontaneous or cyclic messages to the IP address of the computer where PAS is currently running.

## 6.1 Configuring IEC 60870-5 Options

To configure the IEC 60870-5 options:

1. Select IEC 60870-5 Setup from the Meter Setup menu.

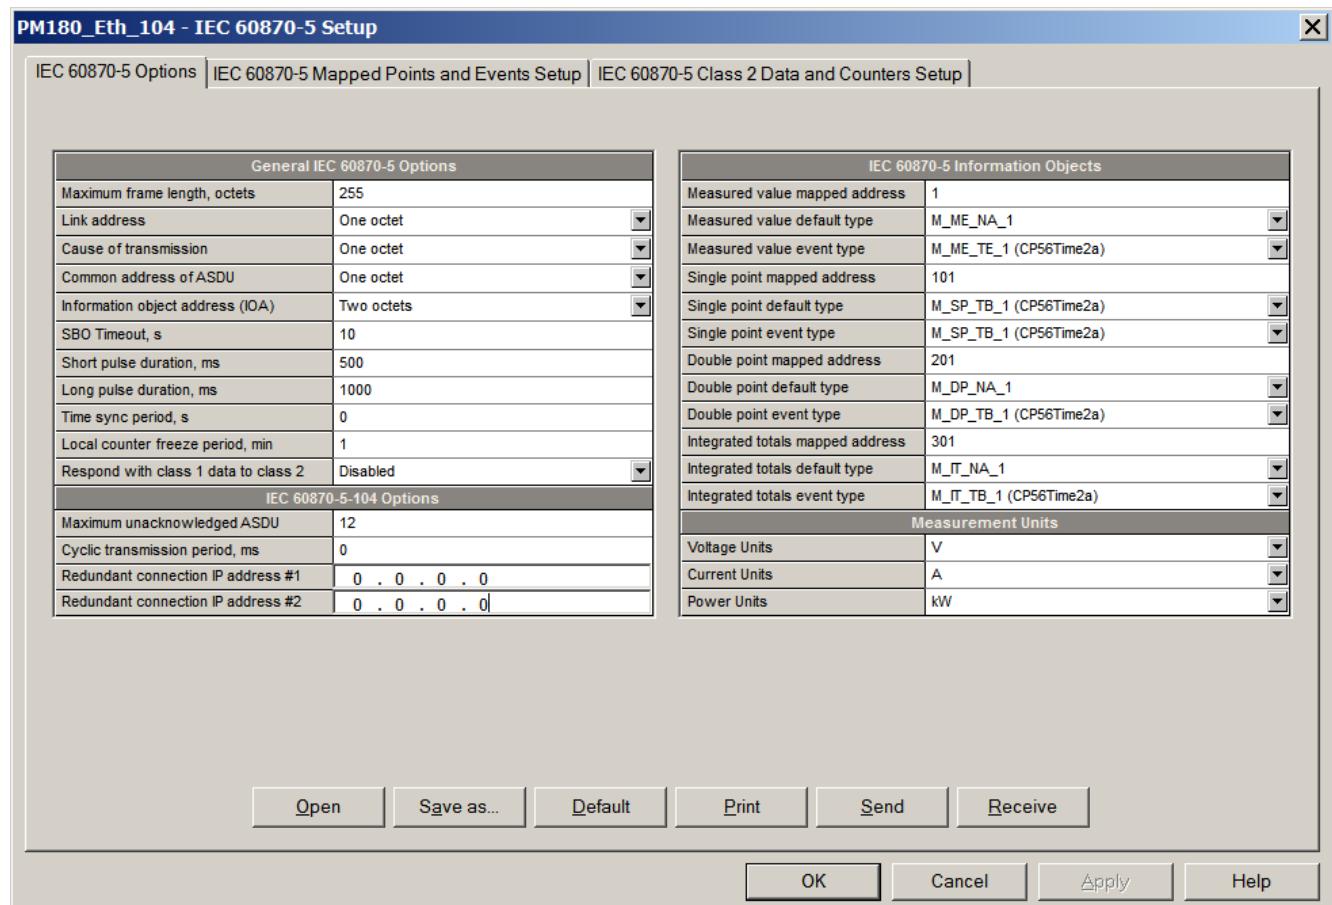

2. Select desired options.
3. Click Save as... to store your setup in the device site database, and click Send to send the setup to the device.

See the following table for available options.

Parameter	Options	Default	Description
<b>General IEC 60870-5 Options</b>			
Maximum frame length	32-255 octets	255	The maximum length of the transmission frame. In IEC 60870-5-104 it is fixed to 253 octets.
Link address	1-2 octets	1	Link address length
Cause of transmission	1-2 octets	1	Cause of transmission length. In IEC 60870-5-104 it is fixed to 2 octets.
Common address of ASDU	1-2 octets	1	Length of common address of ASDU. In IEC 60870-5-104 it is fixed to 2 octets.
Information object address	1-3 octets	2	Length of information object address In IEC 60870-5-104 it is fixed to 3 octets.
SBO Timeout, s	0-30 s	10	Select-before-operate (SBO) timeout for single point commands with a select qualifier
Short pulse duration, ms	100-3000 ms	500	Short pulse duration for single point commands with a short pulse qualifier
Long pulse duration, ms	100-3000 ms	1000	Long pulse duration for single point commands with a long pulse qualifier
Time sync period, s	1-86400 s, 0=not active	0	The time interval between periodic time synchronization requests
Local counter freeze period, min	1-60 min, 0=not active	0	The period of local counter freeze and spontaneous transmission of integrated totals
Respond with class 1 data to class 2	0=disabled, 1=enabled	Disabled	If enabled, the meter will respond with class 1 data to class 2 requests when there is no class 2 data in transmission
<b>IEC 60870-5-104 Options</b>			
Maximum unacknowledged ASDU	1-32, 0=unlimited	12	The maximum number of unacknowledged ASDU allowed before suspending data transmission. Unlimited when set to 0.
Cyclic transmission period, ms	100-30000 ms, 0=not active	0	The period of cyclic/periodic data transmission via the IEC 60870-5-104 port
Redundant connection IP address #1	0.0.0.0 =not active	0.0.0.0	First IP address of the controlling station as a member of Redundant connection group. See below for PM180 Redundancy explanation.
Redundant connection IP address #2	0.0.0.0 =not active	0.0.0.0	Second IP address of the controlling station as a member of Redundant connection group. See below for PM180 Redundancy explanation.
<b>IEC 60870-5 Information Objects</b>			
Measured value mapped address	1-4095	1	Starting address for mapped static measured value objects

Parameter	Options	Default	Description
Measured value default type	M_ME_NA_1 M_ME_NB_1 M_ME_NC_1 M_ME_TA_1 M_ME_TB_1 M_ME_TC_1 M_ME_TD_1 M_ME_TE_1 M_ME_TF_1	M_ME_NB_1	The default type of static measured value objects for Read requests
Measured value event type	M_ME_TA_1 M_ME_TB_1 M_ME_TC_1 M_ME_TD_1 M_ME_TE_1 M_ME_TF_1	M_ME_TE_1	The default type of measured value objects for event reporting
Single point mapped address	1-4095	101	Starting address for mapped static single point objects
Single point default type	M_SP_NA_1 M_SP_TA_1 M_SP_TB_1	M_SP_NA_1	The default type of static single point objects for Read requests
Single point event type	M_SP_TA_1 M_SP_TB_1	M_SP_TB_1	The default type of single point objects for event reporting
Double point mapped address	1-4095	201	Starting address for mapped static double point objects
Double point default type	M_DP_NA_1 M_DP_TA_1 M_DP_TB_1	M_DP_NA_1	The default type of static double point objects for Read requests
Double point event type	M_DP_TA_1 M_DP_TB_1	M_DP_TB_1	The default type of double point objects for event reporting
Integrated totals mapped address	1-4095	301	Starting address for mapped static integrated totals objects
Integrated totals default type	M_IT_NA_1 M_IT_TA_1 M_IT_TB_1	M_IT_NA_1	The default type of static integrated totals for Read requests
Integrated totals event type	M_IT_TA_1 M_IT_TB_1	M_IT_TB_1	The default type of integrated totals for event reporting
<b>Measurement Units</b>			
Voltage units	0=V, 1=kV	V	Units of voltage measured values
Current units	0=A, 1=kA	A	Units of current measured values
Power units	0=kW, 1=MW	kW	Units of power measured values

NOTES:

1. In IEC 60870-5-104 the maximum length of the variable frame, the common address of ASDU, information object address and cause of transmission length are permanently set to values indicated in the table and the optional settings are ignored.
2. Selecting the one-octet information object address length for IEC 60870-5-101 will limit the range of objects to only mapped points in the range of 1 to 255 and will make impossible configuring IEC 60870-5 in the device via IEC 60870-5-101 ports.
3. PM180 Redundancy IEC60870-5-104 implementation.

Redundant connection options using IEC 60870-5-104 can be achieved by generating two logical connections between PM180 and two master/redundant stations. The station which performs the connection referred to as the control station, while the other station, which accepted the connection, called controlled station.

The following general rules apply to redundant connections:

- The controlling and controlled station should be able to create and maintain multiple (in this implementation, 2) logical connections.
- 2 logical links considered as a redundancy group.
- Only one logical connection in the group, at a time, may be able to send/receive user data.
- Controlling station decides which of the connection should be in the state of send / receive user data.
- The test frames ("keep alive" frames) used to maintain all redundancy connections alive = in active state.
- All redundancy group connections rely on one process task (one database/event buffer).

The following table describes device behavior for all combination of the two IP addresses definitions.

IP address setting		Actions
Redundant IP address #1	0.0.0.0 (by default)	Any IEC 60870-5-104 master can communicate with device. General interrogation, Counter interrogation, Clock Synchronization and Read commands allowed.
Redundant IP address #2	0.0.0.0 (by default)	
Redundant IP address #1	192.168.0.119 (example)	Spontaneous, Counter Periodic and Cyclic data transmissions not supported.
Redundant IP address #2	0.0.0.0 (by default)	Redundancy not archived.
Redundant IP address #1	0.0.0.0 (by default)	
Redundant IP address #2	192.168.0.41 (example)	
Redundant IP address #1	192.168.0.119 (example)	This is the <b>only combination</b> which allows redundancy. The two valid IP's <b>must be set and shall be different</b> from each other (IP #1 for the master and the IP #2 for the redundant). Both IP's must be active and send "Test" frames ("keep alive" frames) at a time. Each connection can send STARTDT frame (or STOPDT). When one connection has started data transmission it will get all data frames that were configured: Spontaneous, Cyclic parodic and etc.
Redundant IP address #2	192.168.0.41 (example)	


## 6.2 Remapping Point Addresses and Event Reporting

### NOTE:

The process measurement scales for most analog values depend on your external PT and CT settings and on the voltage and current scales defined in the meter. Configure them in your meter and save to the device site database before configuring event deadbands. See Basic Setup and Device Options Setup in the PM180 Installation and Operation Manual on how to configure these parameters in the meter.

To remap static object point addresses to the configurable address space and to configure corresponding event objects:

1. Select IEC 60870-5 Setup from the Meter Setup menu, and then click on the IEC 60870-5 Mapped Points and Events tab.

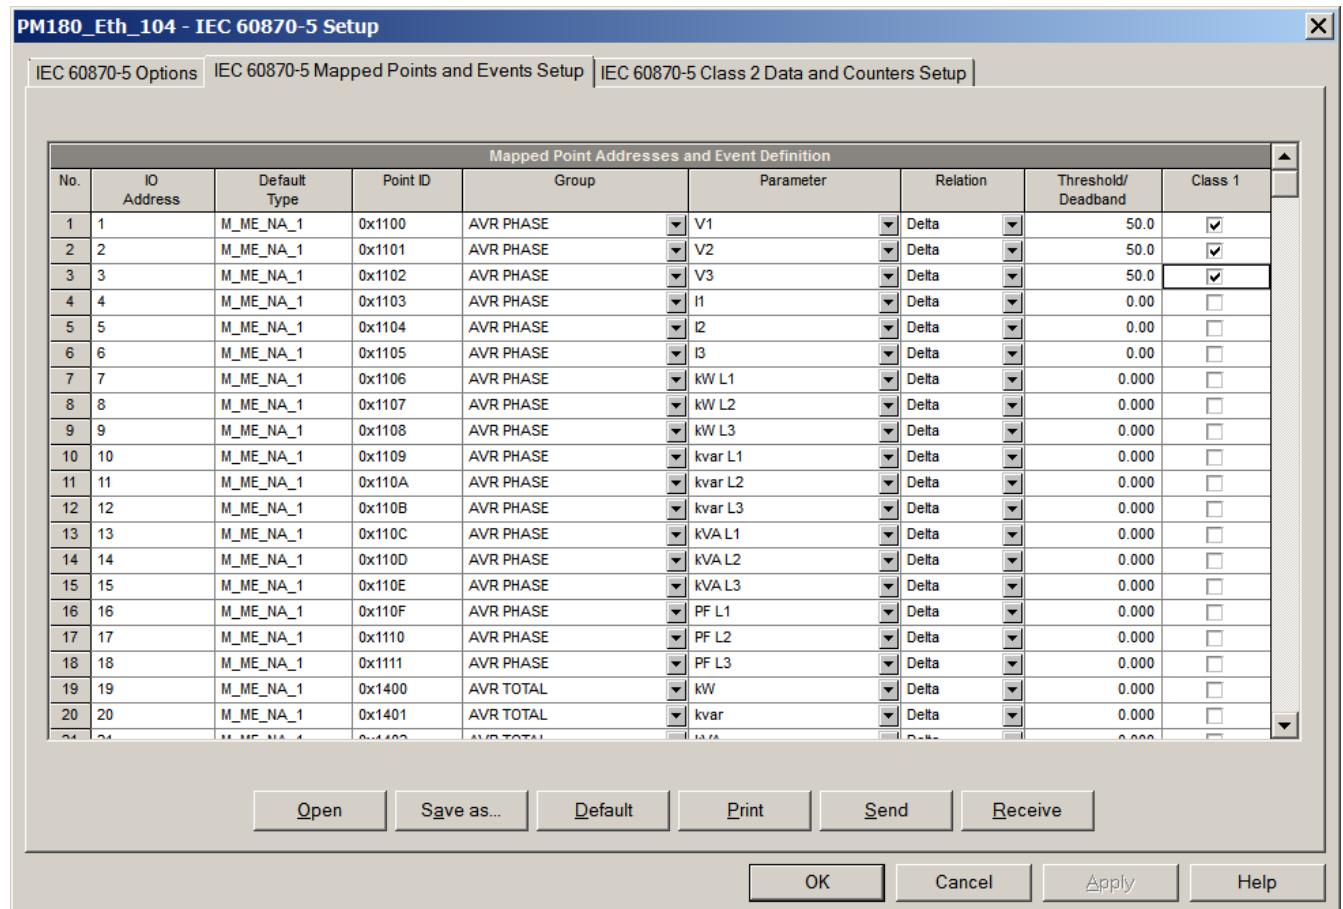

2. Select an object group and parameter for points you wish to remap. Object types and addresses are assigned automatically upon the starting mapped address and default static type you selected for the type of objects in the IEC 60870-5 Options Setup (See Section 6.1). When saving the setup to the device database or sending to the meter all points are automatically arranged in the order: measured values, single point objects, double point objects, integrated totals. See Section 3.2 for the entire list of available information objects.
3. If you wish to use a static point for reporting events, select a relation and an operating threshold or a deadband to be used for detecting events and check the Class 1 box for the point. See Section 2.8 for more information on event reporting. The following options are available:
  - Delta – a new event is reported when the absolute value of the difference between the last reported point value

and its current value exceeds the specified deadband value, or the status of a binary point changes. Measured values with a zero deadband will not be checked for events;

- More than (over) - a new event is reported when the point value rises over the specified threshold, and then when it returns below the threshold minus a predefined return hysteresis – applicable for measured values;
- Less than (under) - a new event is reported when the point value drops below the specified threshold, and then when it returns above the threshold plus a predefined return hysteresis – applicable for measured values.

Hysteresis of the return threshold for measured values is 0.05 Hz for frequency and 2% of the operating threshold for other points.

All thresholds/deadbands for measured values should be specified in primary units.


4. Click Save as... to store your setup in the device site database, and click Send to send the setup to the device.

### **6.3 Configuring Class 2 Data and Counter Transmission**

This setup allows you to configure object address ranges for interrogation, cyclic/periodic data transmission, and spontaneous counter transmission with or without local freeze/reset.

To configure object address ranges for data transmission:

- Select IEC 60870-5 Setup from the Meter Setup menu, and then click on the IEC 60870-5 Class 2 Data and Counters tab.

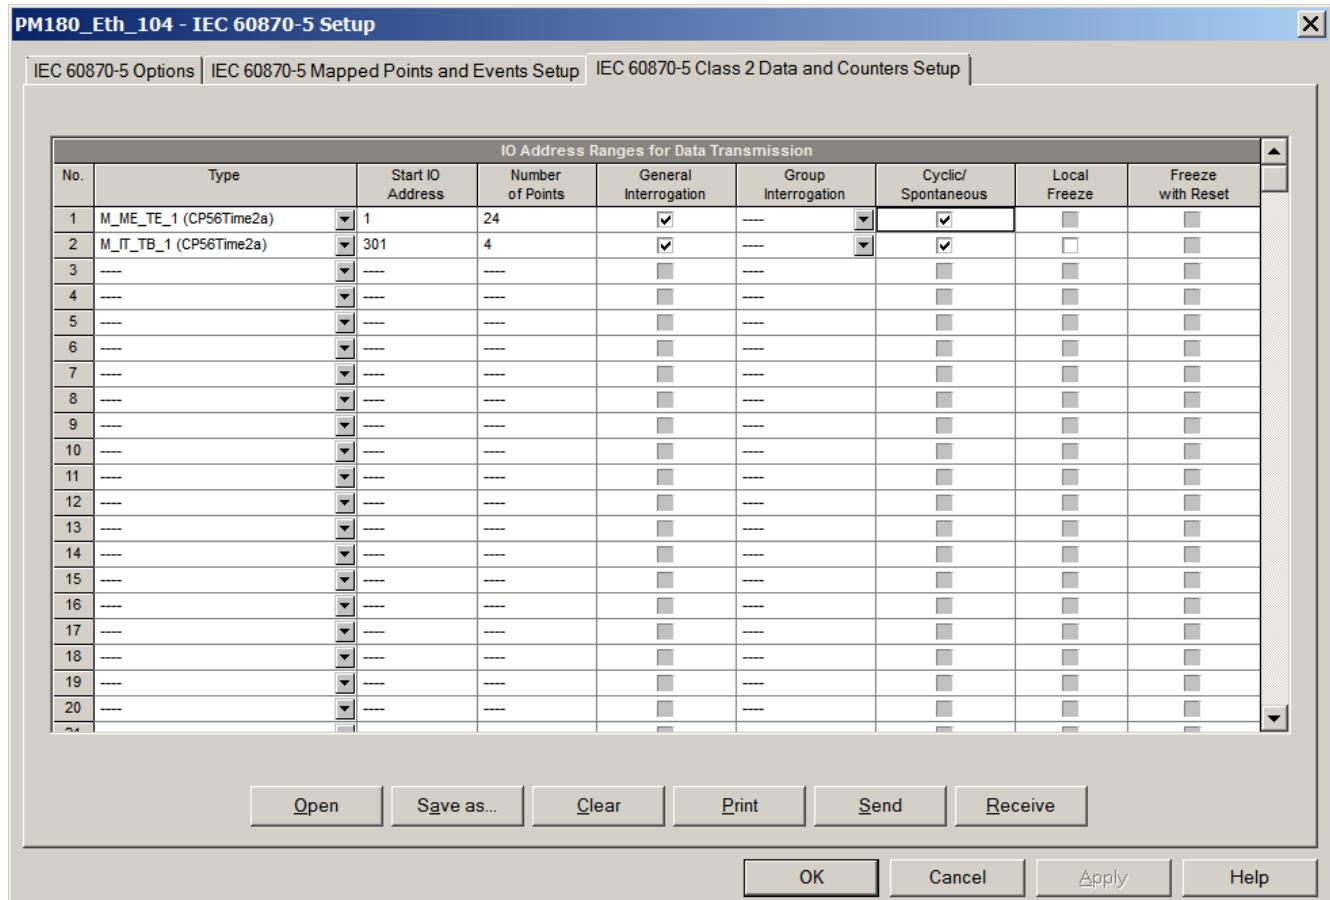

- Select object type and specify ranges of points to be included into interrogation responses or/and cyclic/spontaneous data transmission. Only mapped point addresses (see Section 6.2) and general object addresses listed in Section 3.2 can be used for interrogation and cyclic/spontaneous transmission. See Section 3.2 for compatible object types.

Up to 32 address ranges can be selected. Fill rows in succession without gaps. The first blank row will be taken as the end of a range list.

#### NOTE:

Though double point objects occupy two adjacent addresses, always specify the actual number of requested double points as you define other object ranges.

Class 2 interrogated and cyclic/spontaneous data are always transmitted in the order they are listed in the setup. If you put ranges of point of the same type at continuous rows, they will be packed together and transmitted using minimum number of frames.

- Check the "General Interrog" box for ranges you wish to include into the general/station interrogation.
- Select appropriate groups in the "Group Interrog" box for ranges you wish to include into group interrogation. Each range of points can be allocated for both global and group interrogation.
- Check the "Cyclic/Spont." box for ranges you wish to include into cyclic/spontaneous data transmission.

Analog and binary data checked for cyclic transmission will be transmitted as cyclic messages. The IEC 60870-5-104 cyclic data transmission period is configurable via the IEC 60870-5 Options setup (see Section 6.1).

Integrated totals checked for spontaneous transmission will be transmitted as spontaneous messages at configurable local counter freeze/transmission intervals (see Section 6.1).

6. Check the “Local Freeze” box for A and B modes of transmission of integrated totals with local freeze. See Section 6.1 on how to set up the local counter freeze period. See Section 2.7 for more information on frozen counters operation and transmission.

NOTE:

Counters checked for spontaneous transmission without local freeze will be periodically reported at specified counter freeze/transmission intervals either with the frozen counter values if a remote freeze command was issued for counters before (mode D of acquisition of integrated totals), or with the actual counter values for counters that were not frozen.

7. Check the “Freeze with Reset” box for integrated totals for which local freeze with reset should be applied.
8. Click Save as... to store your setup in the device site database, and click Send to send the setup to the device.

# **Appendix A IEC 60870-5 Interoperability Profile**

The following sections contain the device interoperability profile in a form derived from IEC 60870-5-101:2003 and IEC 60870-5-104:2006.

## **A.1 IEC 60870-5-101 Protocol Implementation Conformance Statement (PICS)**

### **Excerpt from IEC 60870-5-101:2003, Clause 8:**

This companion standard presents sets of parameters and alternatives from which subsets have to be selected to implement particular telecontrol systems. Certain parameter values, such as the number of octets in the COMMON ADDRESS of ASDUs represent mutually exclusive alternatives. This means that only one value of the defined parameters is admitted per system. Other parameters, such as the listed set of different process information in command and in monitor direction allow the specification of the complete set or subsets, as appropriate for given applications. This Clause summarizes the parameters of the previous Clauses to facilitate a suitable selection for a specific application. If a system is composed of equipment stemming from different manufacturers, it is necessary that all partners agree on the selected parameters.

The selected parameters should be marked in the white boxes as follows:

- Function or ASDU is not used
- Function or ASDU is used as standardized (default)
- Function or ASDU is used in reverse mode
- Function or ASDU is used in standard and reverse mode

The possible selection (blank, X, R, or B) is specified for each specific Clause or parameter.

NOTE: In addition, the full specification of a system may require individual selection of certain parameters for certain parts of the system, such as the individual selection of scaling factors for individually addressable measured values.

### **A.1.1 System or device**

(system-specific parameter, indicate the definition of a system or a device by marking one of the following with an "x")

- System definition
- Controlling station definition (master)
- Controlled station definition (slave)

### **A.1.2 Network configuration**

(network-specific parameter, all configurations that are used are to be marked with an "x")

- |   |  |
|---|--|
| <input checked="" type="checkbox"/> Point-to-point          | <input checked="" type="checkbox"/> Multipoint-partyline |
| <input checked="" type="checkbox"/> Multiple point-to-point | <input type="checkbox"/> Multipoint-star                 |

### **A.1.3 Physical layer**

(network-specific parameter, all interfaces and data rates that are used are to be marked with an "x")

### Transmission speed (control direction)

Unbalanced interchange Circuit V.24/V.28 Standard	Unbalanced interchange Circuit V.24/V.28 Recommended if >1 200 bit/s	Balanced interchange Circuit X.24/X.27
<input type="checkbox"/> 100 bit/s	<input checked="" type="checkbox"/> 2 400 bit/s	<input checked="" type="checkbox"/> 2 400 bit/s
<input type="checkbox"/> 200 bit/s	<input checked="" type="checkbox"/> 4 800 bit/s	<input checked="" type="checkbox"/> 4 800 bit/s
<input checked="" type="checkbox"/> 300 bit/s	<input checked="" type="checkbox"/> 9 600 bit/s	<input checked="" type="checkbox"/> 9 600 bit/s
<input checked="" type="checkbox"/> 600 bit/s		<input checked="" type="checkbox"/> 19 200 bit/s
<input checked="" type="checkbox"/> 1 200 bit/s		<input checked="" type="checkbox"/> 38 400 bit/s

\* Additionally supported baud rates: 57600 bit/s, 115200 bit/s.

### Transmission speed (monitor direction)

Unbalanced interchange Circuit V.24/V.28 Standard	Unbalanced interchange Circuit V.24/V.28 Recommended if >1 200 bit/s	Balanced interchange Circuit X.24/X.27
<input type="checkbox"/> 100 bit/s	<input checked="" type="checkbox"/> 2 400 bit/s	<input checked="" type="checkbox"/> 2 400 bit/s
<input type="checkbox"/> 200 bit/s	<input checked="" type="checkbox"/> 4 800 bit/s	<input checked="" type="checkbox"/> 4 800 bit/s
<input checked="" type="checkbox"/> 300 bit/s	<input checked="" type="checkbox"/> 9 600 bit/s	<input checked="" type="checkbox"/> 9 600 bit/s
<input checked="" type="checkbox"/> 600 bit/s		<input checked="" type="checkbox"/> 19 200 bit/s
<input checked="" type="checkbox"/> 1 200 bit/s		<input checked="" type="checkbox"/> 38 400 bit/s

\* Additionally supported baud rates: 57600 bit/s, 115200 bit/s.

### A.1.4 Link layer

(network-specific parameter, all options that are used are to be marked with an "x". Specify the maximum frame length. If a non-standard assignment of class 2 messages is implemented for unbalanced transmission, indicate the type ID and COT of all messages assigned to class 2.)

Frame format FT 1.2, single character 1 and the fixed time out interval are used exclusively in this companion standard.

Link transmission procedure	Address field of the link
<input type="checkbox"/> Balanced transmission	<input type="checkbox"/> Not present (balanced transmission only)
<input checked="" type="checkbox"/> Unbalanced transmission	<input checked="" type="checkbox"/> One octet
Frame length	
<input checked="" type="checkbox"/> Maximum length L (control direction)	<input type="checkbox"/> Structured
<input checked="" type="checkbox"/> Maximum length L (monitor direction)	<input checked="" type="checkbox"/> Unstructured
<input type="checkbox"/> Time during which repetitions are permitted (Trp) or number of repetitions	

When using an unbalanced link layer, the following ASDU types are returned in class 2 messages (low priority) with the indicated causes of transmission:

- The standard assignment of ASDUs to class 2 messages is used as follows:

Type identification	Cause of transmission
9, 11, 13, 21	<1>

- A special assignment of ASDUs to class 2 messages is used as follows:

Type identification	Cause of transmission
1, 2, 9-16, 30, 34-37	<20> to <35>, <37> to <41>

NOTE: In response to a class 2 poll, a controlled station may respond with class 1 data when there is no class 2 data available.

## A.1.5 Application layer

### Transmission mode for application data

Mode 1 (least significant octet first), as defined in 4.10 of IEC 60870-5-4, is used exclusively in this companion standard.

### Common address of ASDU

(system-specific parameter, all configurations that are used are to be marked with an "x")

- One octet                            Two octets

### Information object address

(system-specific parameter, all configurations that are used are to be marked with an "x")

- |  |  |
|--|--|
| <input checked="" type="checkbox"/> One octet    | <input checked="" type="checkbox"/> Structured |
| <input checked="" type="checkbox"/> Two octets   | <input type="checkbox"/> Unstructured          |
| <input checked="" type="checkbox"/> Three octets |  |

### Cause of transmission

(system-specific parameter, all configurations that are used are to be marked with an "x")

- One octet                            Two octets (with originator address)  
Originator address is set to zero if not used

### Selection of standard ASDUs

#### Process information in monitor direction

(station-specific parameter, mark each type ID with an "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- |  |           |
|--|-----------|
| <input checked="" type="checkbox"/> <1> := Single-point information                                  | M_SP_NA_1 |
| <input checked="" type="checkbox"/> <2> := Single-point information with time tag                    | M_SP_TA_1 |
| <input checked="" type="checkbox"/> <3> := Double-point information                                  | M_DP_NA_1 |
| <input checked="" type="checkbox"/> <4> := Double-point information with time tag                    | M_DP_TA_1 |
| <input type="checkbox"/> <5> := Step position information  | M_ST_NA_1 |
| <input type="checkbox"/> <6> := Step position information with time tag                              | M_ST_TA_1 |
| <input type="checkbox"/> <7> := Bitstring of 32 bit  | M_BO_NA_1 |
| <input type="checkbox"/> <8> := Bitstring of 32 bit with time tag                                    | M_BO_TA_1 |
| <input checked="" type="checkbox"/> <9> := Measured value, normalized value                          | M_ME_NA_1 |
| <input checked="" type="checkbox"/> <10> := Measured value, normalized value with time tag           | M_ME_TA_1 |
| <input checked="" type="checkbox"/> <11> := Measured value, scaled value                             | M_ME_NB_1 |
| <input checked="" type="checkbox"/> <12> := Measured value, scaled value with time tag               | M_ME_TB_1 |
| <input checked="" type="checkbox"/> <13> := Measured value, short floating point value               | M_ME_NC_1 |
| <input checked="" type="checkbox"/> <14> := Measured value, short floating point value with time tag | M_ME_TC_1 |

<input checked="" type="checkbox"/> <15> := Integrated totals	M_IT_NA_1
<input checked="" type="checkbox"/> <16> := Integrated totals with time tag	M_IT_TA_1
<input type="checkbox"/> <17> := Event of protection equipment with time tag	M_EP_TA_1
<input type="checkbox"/> <18> := Packed start events of protection equipment with time tag	M_EP_TB_1
<input type="checkbox"/> <19> := Packed output circuit information of protection equipment with time tag	M_EP_TC_1
<input type="checkbox"/> <20> := Packed single-point information with status change detection	M_PS_NA_1
<input type="checkbox"/> <21> := Measured value, normalized value without quality descriptor	M_ME_ND_1
<input checked="" type="checkbox"/> <30> := Single-point information with time tag CP56Time2a	M_SP_TB_1
<input checked="" type="checkbox"/> <31> := Double-point information with time tag CP56Time2a	M_DP_TB_1
<input type="checkbox"/> <32> := Step position information with time tag CP56Time2a	M_ST_TB_1
<input type="checkbox"/> <33> := Bitstring of 32 bit with time tag CP56Time2a	M_BO_TB_1
<input checked="" type="checkbox"/> <34> := Measured value, normalized value with time tag CP56Time2a	M_ME_TD_1
<input checked="" type="checkbox"/> <35> := Measured value, scaled value with time tag CP56Time2a	M_ME_TE_1
<input checked="" type="checkbox"/> <36> := Measured value, short floating point value with time tag CP56Time2a	M_ME_TF_1
<input checked="" type="checkbox"/> <37> := Integrated totals with time tag CP56Time2a	M_IT_TB_1
<input type="checkbox"/> <38> := Event of protection equipment with time tag CP56Time2a	M_EP_TD_1
<input type="checkbox"/> <39> := Packed start events of protection equipment with time tag CP56Time2a	M_EP_TE_1
<input type="checkbox"/> <40> := Packed output circuit information of protection equipment with time tag P56Time2a	M_EP_TF_1

Either ASDUs of the set <2>, <4>, <6>, <8>, <10>, <12>, <14>, <16>, <17>, <18>, <19> or of the set <30-40> are used.

### Process information in control direction

(station-specific parameter, mark each type ID with an “x” if it is only used in the standard direction, “R” if only used in the reverse direction, and “B” if used in both directions)

<input checked="" type="checkbox"/> <45> := Single command	C_SC_NA_1
<input checked="" type="checkbox"/> <46> := Double command	C_DC_NA_1
<input type="checkbox"/> <47> := Regulating step command	C_RC_NA_1
<input type="checkbox"/> <48> := Set point command, normalized value	C_SE_NA_1
<input type="checkbox"/> <49> := Set point command, scaled value	C_SE_NB_1
<input type="checkbox"/> <50> := Set point command, short floating point value	C_SE_NC_1
<input type="checkbox"/> <51> := Bitstring of 32 bit	C_BO_NA_1

### System information in monitor direction

(station-specific parameter, mark with an “x” if it is only used in the standard direction, “R” if only used in the reverse direction, and “B” if used in both directions)

<input checked="" type="checkbox"/> <70> := End of initialization	M_EI_NA_1
---	-----------

### System information in control direction

(station-specific parameter, mark each type ID with an “x” if it is only used in the standard direction, “R” if only used in the reverse direction, and “B” if used in both directions)

<input checked="" type="checkbox"/> <100> := Interrogation command	C_IC_NA_1
<input checked="" type="checkbox"/> <101> := Counter interrogation command	C_CI_NA_1
<input checked="" type="checkbox"/> <102> := Read command	C_RD_NA_1
<input checked="" type="checkbox"/> <103> := Clock synchronization command	C_CS_NA_1
<input checked="" type="checkbox"/> <104> := Test command	C_TS_NA_1

- |                          |                                    |           |
|--------------------------|------------------------------------|-----------|
| <input type="checkbox"/> | <105> := Reset process command     | C_RP_NA_1 |
| <input type="checkbox"/> | <106> := Delay acquisition command | C_CD_NA_1 |

### Parameter in control direction

(station-specific parameter, mark each type ID with an "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- |                                     |  |           |
|-------------------------------------|--|-----------|
| <input type="checkbox"/>            | <110> := Parameter of measured value, normalized value           | P_ME_NA_1 |
| <input checked="" type="checkbox"/> | <111> := Parameter of measured value, scaled value               | P_ME_NB_1 |
| <input checked="" type="checkbox"/> | <112> := Parameter of measured value, short floating point value | P_ME_NC_1 |
| <input type="checkbox"/>            | <113> := Parameter activation                                    | P_AC_NA_1 |

### File transfer

(station-specific parameter, mark each type ID with an "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- |                          |   |           |
|--------------------------|---|-----------|
| <input type="checkbox"/> | <120> := File ready   | F_FR_NA_1 |
| <input type="checkbox"/> | <121> := Section ready  | F_SR_NA_1 |
| <input type="checkbox"/> | <122> := Call directory, select file, call file, call section                   | F_SC_NA_1 |
| <input type="checkbox"/> | <123> := Last section, last segment   | F_LS_NA_1 |
| <input type="checkbox"/> | <124> := Ack file, ack section  | F_AF_NA_1 |
| <input type="checkbox"/> | <125> := Segment  | F_SG_NA_1 |
| <input type="checkbox"/> | <126> := Directory {blank or X, only available in monitor (standard) direction} | F_DR_TA_1 |

### Type identification and cause of transmission assignments

(station-specific parameters)

Blank = function or ASDU is not used.

Mark type identification/cause of transmission combinations:

"x" if used only in the standard direction;

"R" if used only in the reverse direction;

"B" if used in both directions.

Type identification		Cause of transmission																			
		1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47	
<1>	M_SP_NA_1	x				x										x					
<2>	M_SP_TA_1	x		x	x											x					
<3>	M_DP_NA_1	x				x										x					
<4>	M_DP_TA_1	x		x	x											x					
<5>	M_ST_NA_1																				
<6>	M_ST_TA_1																				
<7>	M_BO_NA_1																				
<8>	M_BO_TA_1																				
<9>	M_ME_NA_1	x				x										x					
<10>	M_ME_TA_1	x		x	x											x					
<11>	M_ME_NB_1	x				x										x					
<12>	M_ME_TB_1	x		x	x											x					
<13>	M_ME_NC_1	x				x										x					
<14>	M_ME_TC_1	x		x	x											x					

Type identification		Cause of transmission																			
		1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47	
<15>	M_IT_NA_1	x			x											x					
<16>	M_IT_TA_1	x		x	x											x					
<17>	M_EP_TA_1																				
<18>	M_EP_TB_1																				
<19>	M_EP_TC_1																				
<20>	M_PS_NA_1																				
<21>	M_ME_ND_1																				
<30>	M_SP_TB_1	x		x	x											x					
<31>	M_DP_TB_1	x		x	x											x					
<32>	M_ST_TB_1																				
<33>	M_BO_TB_1																				
<34>	M_ME_TD_1	x		x	x											x					
<35>	M_ME_TE_1	x		x	x											x					
<36>	M_ME_TF_1	x		x	x											x					
<37>	M_IT_TB_1	x		x	x												x				
<38>	M_EP_TD_1																				
<39>	M_EP_TE_1																				
<40>	M_EP_TF_1																				
<45>	C_SC_NA_1						x	x	x	x	x						x	x	x		
<46>	C_DC_NA_1						x	x	x	x	x						x	x	x		
<47>	C_RC_NA_1																				
<48>	C_SE_NA_1																				
<49>	C_SE_NB_1																				
<50>	C_SE_NC_1																				
<51>	C_BO_NA_1																				
<70>	M_EI_NA_1				x																
<100>	C_IC_NA_1					x	x				x						x	x			
<101>	C_CI_NA_1					x	x			x							x	x			
<102>	C_RD_NA_1					x											x	x	x		
<103>	C_CS_NA_1						x	x									x	x			
<104>	C_TS_NA_1																				
<105>	C_RP_NA_1																				
<106>	C_CD_NA_1																				
<110>	P_ME_NA_1																				
<111>	P_ME_NB_1					x															
<112>	P_ME_NC_1					x															
<113>	P_AC_NA_1																				
<120>	F_FR_NA_1																				
<121>	F_SR_NA_1																				
<122>	F_SC_NA_1																				
<123>	F_LS_NA_1																				
<124>	F_AF_NA_1																				
<125>	F_SG_NA_1																				
<126>	F_DR_TA_1																				

\* Blank or x only

## A.1.6 Basic application functions

### Station initialization

(station-specific parameter, mark with an "x" if function is used)

- Remote initialization

### Cyclic data transmission

(station-specific parameter, mark with an "x" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Cyclic data transmission

### Read procedure

(station-specific parameter, mark with an "x" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Read procedure

### Spontaneous transmission

(station-specific parameter, mark with an "x" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Spontaneous transmission

### Double transmission of information objects with cause of transmission spontaneous

(station-specific parameter, mark each information type with an "X" where both a type ID without time and corresponding type ID with time are issued in response to a single spontaneous change of a monitored object)

The following type identifications may be transmitted in succession caused by a single status change of an information object. The particular information object addresses for which double transmission is enabled are defined in a project-specific list.

- Single-point information M\_SP\_NA\_1, M\_SP\_TA\_1, M\_SP\_TB\_1 ~~and M\_PS\_NA\_1~~
- Double-point information M\_DP\_NA\_1, M\_DP\_TA\_1 and M\_DP\_TB\_1
- Step position information M\_ST\_NA\_1, M\_ST\_TA\_1 and M\_ST\_TB\_1
- Bitstring of 32 bit M\_BO\_NA\_1, M\_BO\_TA\_1 and M\_BO\_TB\_1 (if defined for a specific project, see 7.2.1.1)
- Measured value, normalized value M\_ME\_NA\_1, M\_ME\_TA\_1, ~~M\_ME\_TD\_1~~ and M\_ME\_TE\_1
- Measured value, scaled value M\_ME\_NB\_1, M\_ME\_TB\_1 and M\_ME\_TE\_1
- Measured value, short floating point number M\_ME\_NC\_1, M\_ME\_TC\_1 ~~and M\_ME\_TF\_1~~

### Station interrogation

(station-specific parameter, mark with an "x" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- |   |  |  |  |
|---|--|--|--|
| <input checked="" type="checkbox"/> global  |  |  |  |
| <input checked="" type="checkbox"/> group 1 | <input checked="" type="checkbox"/> group 7  | <input checked="" type="checkbox"/> group 13 |  |
| <input checked="" type="checkbox"/> group 2 | <input checked="" type="checkbox"/> group 8  | <input checked="" type="checkbox"/> group 14 |  |
| <input checked="" type="checkbox"/> group 3 | <input checked="" type="checkbox"/> group 9  | <input checked="" type="checkbox"/> group 15 |  |
| <input checked="" type="checkbox"/> group 4 | <input checked="" type="checkbox"/> group 10 | <input type="checkbox"/> group 16            |  |
| <input checked="" type="checkbox"/> group 5 | <input checked="" type="checkbox"/> group 11 |  | Information object addresses assigned to each group are configurable (see Section 6.3 in this guide) |
| <input checked="" type="checkbox"/> group 6 | <input checked="" type="checkbox"/> group 12 |  |  |

## Clock synchronization

(station-specific parameter, mark with an "x" if function is used only in the standard direction, "**R**" if used only in the reverse direction, and "**B**" if used in both directions)

- Clock synchronization
- Day of week used
- RES1, GEN (time tag substituted/ not substituted) used
- SU-bit (summertime) used

## Command transmission

(object-specific parameter, mark with an "x" if function is used only in the standard direction, "**R**" if used only in the reverse direction, and "**B**" if used in both directions)

- Direct command transmission
- Direct set point command transmission
- Select and execute command
- Select and execute set point command
- C\_SE ACTTERM used
- No additional definition
- Short-pulse duration (duration determined by a system parameter in the controlled station)
- Long-pulse duration (duration determined by a system parameter in the controlled station)
- Persistent output

## Transmission of integrated totals

(station- or object-specific parameter, mark with an "x" if function is used only in the standard direction, "**R**" if used only in the reverse direction, and "**B**" if used in both directions)

- Mode A: local freeze with spontaneous transmission
- Mode B: local freeze with counter interrogation
- Mode C: freeze and transmit by counter interrogation commands
- Mode D: freeze by counter-interrogation command, frozen values reported spontaneously
- Counter read
- Counter freeze without reset
- Counter freeze with reset
- Counter reset
- General request counter
- Request counter group 1
- Request counter group 2
- Request counter group 3
- Request counter group 4

## Parameter loading

(object-specific parameter, mark with an "x" if function is used only in the standard direction, "**R**" if used only in the reverse direction, and "**B**" if used in both directions)

- Threshold value
- Smoothing factor

- Low limit for transmission of measured value
- High limit for transmission of measured

### **Parameter activation**

(object-specific parameter, mark with an “x” if function is used only in the standard direction, “R” if used only in the reverse direction, and “B” if used in both directions)

- Act/deact of persistent cyclic or periodic transmission of the addressed object

### **Test procedure**

(station-specific parameter, mark with an “x” if function is used only in the standard direction, “R” if used only in the reverse direction, and “B” if used in both directions)

- Test procedure

### **File transfer**

(station-specific parameter, mark with an “x” if function is used)

#### File transfer in monitor direction

- Transparent file
- Transmission of disturbance data of protection equipment
- Transmission of sequences of events
- Transmission of sequences of recorded analogue values

#### File transfer in control direction

- Transparent file

### **Background scan**

(station-specific parameter, mark with an “x” if function is used only in the standard direction, “R” if used only in the reverse direction, and “B” if used in both directions)

- Background scan

### **Acquisition of transmission delay**

(station-specific parameter, mark with an “x” if function is used only in the standard direction, “R” if used only in the reverse direction, and “B” if used in both directions)

- Acquisition of transmission delay

## **A.2 IEC 60870-5-104 Protocol Implementation Conformance Statement (PICS)**

### **Excerpt from IEC 60870-5-104:2006, Clause 9:**

This companion standard presents sets of parameters and alternatives from which subsets must be selected to implement particular telecontrol systems. Certain parameter values, such as the choice of "structured" or "unstructured" fields of the INFORMATION OBJECT ADDRESS of ASDUs represent mutually exclusive alternatives. This means that only one value of the defined parameters is admitted per system. Other parameters, such as the listed set of different process information in command and in monitor direction allow the specification of the complete set or subsets, as appropriate for given applications. This clause summarizes the parameters of the previous clauses to facilitate a suitable selection for a specific application. If a system is composed of equipment stemming from different manufacturers, it is necessary that all partners agree on the selected parameters.

The interoperability list is defined as in IEC 60870-5-101 and extended with parameters used in this standard. The text descriptions of parameters, which are not applicable to this companion standard, are strike-through (corresponding check box is marked black).

NOTE: In addition, the full specification of a system may require individual selection of certain parameters for certain parts of the system, such as the individual selection of scaling factors for individually addressable measured values.

The selected parameters should be marked in the white boxes as follows:

- Function or ASDU is not used
- Function or ASDU is used as standardized (default)
- Function or ASDU is used in reverse mode
- Function or ASDU is used in standard and reverse mode

The possible selection (blank, X, R, or B) is specified for each specific clause or parameter. A black check box indicates that the option cannot be selected in this companion standard.

### **A.2.1 System or device**

(system-specific parameter, indicate definition of a system or a device by marking one of the following with "X")

- System definition
- Controlling station definition (master)
- Controlled station definition (slave)

### **A.2.2 Network configuration**

(network-specific parameter, all configurations that are used are to be marked "x")

- |   |   |
|---|---|
| <input checked="" type="checkbox"/> Point-to-point          | <input type="checkbox"/> Multipoint-partyline |
| <input checked="" type="checkbox"/> Multiple-point-to-point | <input type="checkbox"/> Multipoint-star      |

### **A.2.3 Physical layer**

(network-specific parameter, all interfaces and data rates that are used are to be marked "x")

### Transmission speed (control direction)

Unbalanced interchange Circuit V.24/V.28 Standard	Unbalanced interchange Circuit V.24/V.28 Recommended if >1 200 bit/s	Balanced interchange Circuit X.24/X.27
<input type="checkbox"/> 100 bit/s	<input type="checkbox"/> 2 400 bit/s	<input type="checkbox"/> 2 400 bit/s
<input type="checkbox"/> 200 bit/s	<input type="checkbox"/> 4 800 bit/s	<input type="checkbox"/> 4 800 bit/s
<input type="checkbox"/> 300 bit/s	<input type="checkbox"/> 9 600 bit/s	<input type="checkbox"/> 9 600 bit/s
<input type="checkbox"/> 600 bit/s		<input type="checkbox"/> 19 200 bit/s
<input type="checkbox"/> 1 200 bit/s		<input type="checkbox"/> 38 400 bit/s

### Transmission speed (monitor direction)

Unbalanced interchange Circuit V.24/V.28 Standard	Unbalanced interchange Circuit V.24/V.28 Recommended if >1 200 bit/s	Balanced interchange Circuit X.24/X.27
<input type="checkbox"/> 100 bit/s	<input type="checkbox"/> 2 400 bit/s	<input type="checkbox"/> 2 400 bit/s
<input type="checkbox"/> 200 bit/s	<input type="checkbox"/> 4 800 bit/s	<input type="checkbox"/> 4 800 bit/s
<input type="checkbox"/> 300 bit/s	<input type="checkbox"/> 9 600 bit/s	<input type="checkbox"/> 9 600 bit/s
<input type="checkbox"/> 600 bit/s		<input type="checkbox"/> 19 200 bit/s
<input type="checkbox"/> 1 200 bit/s		<input type="checkbox"/> 38 400 bit/s

### A.2.4 Link layer

(network-specific parameter, all options that are used are to be marked "x". Specify the maximum frame length. If a non-standard assignment of class 2 messages is implemented for unbalanced transmission, indicate the Type ID and COT of all messages assigned to class 2.)

~~Frame format FT 1.2, single character 1 and the fixed time out interval are used exclusively in this companion standard.~~

#### Link transmission

- Balanced transmission
- Unbalanced transmission

#### Frame length

- Maximum length L (number of octets)

#### Address field of the link

- Not present (balanced transmission only)
- One octet
- Two octets
- Structured
- Unstructured

When using an unbalanced link layer, the following ASDU types are returned in class 2 messages (low priority) with the indicated causes of transmission:

- The standard assignment of ASDUs to class 2 messages is used as follows:

Type identification	Cause of transmission
9, 11, 13, 21	<1>

- A special assignment of ASDUs to class 2 messages is used as follows:

Type identification	Cause of transmission

~~Note: (In response to a class 2 poll, a controlled station may respond with class 1 data when there is no class 2 data available).~~

## A.2.5 Application layer

### Transmission mode for application data

Mode 1 (Least significant octet first), as defined in 4.10 of IEC 60870-5-4, is used exclusively in this companion standard.

### Common address of ASDU

(system-specific parameter, all configurations that are used are to be marked "x")

- One octet
- Two octets

### Information object address

(system-specific parameter, all configurations that are used are to be marked "x")

- One octet
- Two octets
- Three octets
- Structured
- Unstructured

### Cause of transmission

(system-specific parameter, all configurations that are used are to be marked "x")

- One octet
- Two octets (with originator address)  
Originator address is set to zero if not used

### Length of APDU

(system-specific parameter, specify the maximum length of the APDU per system)

The maximum length of APDU for both directions is 253. It is a fixed system parameter.

- 253 Maximum length of APDU per system in control direction
- 253 Maximum length of APDU per system in monitor direction

### Selection of standard ASDUs

#### Process information in monitor direction

(station-specific parameter, mark each Type ID "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- <1> := Single-point information M\_SP\_NA\_1
- <2> := Single-point information with time tag M\_SP\_TA\_1
- <3> := Double-point information M\_DP\_NA\_1
- <4> := Double-point information with time tag M\_DP\_TA\_1
- <5> := Step position information M\_ST\_NA\_1
- <6> := Step position information with time tag M\_ST\_TA\_1
- <7> := Bitstring of 32 bit M\_BO\_NA\_1
- <8> := Bitstring of 32 bit with time tag M\_BO\_TA\_1
- <9> := Measured value, normalized value M\_ME\_NA\_1
- <10> := Measured value, normalized value with time tag M\_ME\_TA\_1
- <11> := Measured value, scaled value M\_ME\_NB\_1
- <12> := Measured value, scaled value with time tag M\_ME\_TB\_1
- <13> := Measured value, short floating point value M\_ME\_NC\_1

<input checked="" type="checkbox"/>	<14> := Measured value, short floating point value with time tag	M_ME_TC_1
<input checked="" type="checkbox"/>	<15> := Integrated totals	M_IT_NA_1
<input checked="" type="checkbox"/>	<16> := Integrated totals with time tag	M_IT_TA_1
<input checked="" type="checkbox"/>	<17> := Event of protection equipment with time tag	M_EP_TA_1
<input checked="" type="checkbox"/>	<18> := Packed start events of protection equipment with time tag	M_EP_TB_1
<input checked="" type="checkbox"/>	<19> := Packed output circuit information of protection equipment with time tag	M_EP_TC_1
<input type="checkbox"/>	<20> := Packed single-point information with status change detection	M_PS_NA_1
<input type="checkbox"/>	<21> := Measured value, normalized value without quality descriptor	M_ME_ND_1
<input checked="" type="checkbox"/>	<30> := Single-point information with time tag CP56Time2a	M_SP_TB_1
<input checked="" type="checkbox"/>	<31> := Double-point information with time tag CP56Time2a	M_DP_TB_1
<input type="checkbox"/>	<32> := Step position information with time tag CP56Time2a	M_ST_TB_1
<input type="checkbox"/>	<33> := Bitstring of 32 bit with time tag CP56Time2a	M_BO_TB_1
<input checked="" type="checkbox"/>	<34> := Measured value, normalized value with time tag CP56Time2a	M_ME_TD_1
<input checked="" type="checkbox"/>	<35> := Measured value, scaled value with time tag CP56Time2a	M_ME_TE_1
<input checked="" type="checkbox"/>	<36> := Measured value, short floating point value with time tag CP56Time2a	M_ME_TF_1
<input checked="" type="checkbox"/>	<37> := Integrated totals with time tag CP56Time2a	M_IT_TB_1
<input type="checkbox"/>	<38> := Event of protection equipment with time tag CP56Time2a	M_EP_TD_1
<input type="checkbox"/>	<39> := Packed start events of protection equipment with time tag CP56Time2a	M_EP_TE_1
<input type="checkbox"/>	<40> := Packed output circuit information of protection equipment with time tag P56Time2a	M_EP_TF_1

In this companion standard only the use of the set <30> – <40> for ASDUs with time tag is permitted.

### Process information in control direction

(station-specific parameter, mark each Type ID "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

<input checked="" type="checkbox"/>	<45> := Single command	C_SC_NA_1
<input checked="" type="checkbox"/>	<46> := Double command	C_DC_NA_1
<input type="checkbox"/>	<47> := Regulating step command	C_RC_NA_1
<input type="checkbox"/>	<48> := Set point command, normalized value	C_SE_NA_1
<input type="checkbox"/>	<49> := Set point command, scaled value	C_SE_NB_1
<input type="checkbox"/>	<50> := Set point command, short floating point value	C_SE_NC_1
<input type="checkbox"/>	<51> := Bitstring of 32 bit	C_BO_NA_1
<input checked="" type="checkbox"/>	<58> := Single command with time tag CP56Time2a	C_SC_TA_1
<input checked="" type="checkbox"/>	<59> := Double command with time tag CP56Time2a	C_DC_TA_1
<input checked="" type="checkbox"/>	<60> := Regulating step command with time tag CP56Time2a	C_RC_TA_1
<input checked="" type="checkbox"/>	<61> := Set point command, normalized value with time tag CP56Time2a	C_SE_TA_1
<input checked="" type="checkbox"/>	<62> := Set point command, scaled value with time tag CP56Time2a	C_SE_TB_1
<input checked="" type="checkbox"/>	<63> := Set point command, short floating point value with time tag CP56Time2a	C_SE_TC_1
<input checked="" type="checkbox"/>	<64> := Bitstring of 32 bit with time tag CP56Time2a	C_BO_TA_1

Either the ASDUs of the set <45> – <51> or of the set <58> – <64> are used.

### System information in monitor direction

(station-specific parameter, mark with an "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

<input checked="" type="checkbox"/>	<70> := End of initialization	M_EI_NA_1
-------------------------------------	-------------------------------	-----------

### System information in control direction

(station-specific parameter, mark each Type ID "X" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

<input checked="" type="checkbox"/>	<100> := Interrogation command	C_IC_NA_1
<input checked="" type="checkbox"/>	<101> := Counter interrogation command	C_CI_NA_1
<input checked="" type="checkbox"/>	<102> := Read command	C_RD_NA_1
<input checked="" type="checkbox"/>	<103> := Clock synchronization command	C_CS_NA_1
<input checked="" type="checkbox"/>	<104> := Test command	C_TS_NA_1
<input type="checkbox"/>	<105> := Reset process command	C_RP_NA_1
<input type="checkbox"/>	<106> := Delay acquisition command	C_CD_NA_1
<input checked="" type="checkbox"/>	<107> := Test command with time tag CP56Time2a	C_TS_TA_1

### Parameter in control direction

(station-specific parameter, mark each Type ID "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

<input type="checkbox"/>	<110> := Parameter of measured value, normalized value	P_ME_NA_1
<input checked="" type="checkbox"/>	<111> := Parameter of measured value, scaled value	P_ME_NB_1
<input checked="" type="checkbox"/>	<112> := Parameter of measured value, short floating point value	P_ME_NC_1
<input type="checkbox"/>	<113> := Parameter activation	P_AC_NA_1

### File transfer

(station-specific parameter, mark each Type ID "x" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

<input type="checkbox"/>	<120> := File ready	F_FR_NA_1
<input type="checkbox"/>	<121> := Section ready	F_SR_NA_1
<input type="checkbox"/>	<122> := Call directory, select file, call file, call section	F_SC_NA_1
<input type="checkbox"/>	<123> := Last section, last segment	F_LS_NA_1
<input type="checkbox"/>	<124> := Ack file, ack section	F_AF_NA_1
<input type="checkbox"/>	<125> := Segment	F_SG_NA_1
<input type="checkbox"/>	<126> := Directory {blank or X, only available in monitor (standard) direction}	F_DR_TA_1
<input type="checkbox"/>	<127> := Query Log – Request archive file	F_SC_NB_1

### Type identifier and cause of transmission assignments

(station-specific parameters)

Blank: functions or ASDU not used.

Mark Type Identification/Cause of transmission combinations:

"x" if only used in the standard direction;  
 "R" if only used in the reverse direction;  
 "B" if used in both directions.

Type identification		Cause of transmission																			
		1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47	
<1>	M_SP_NA_1	x		x	x											x					
<2>	M_SP_TA_1																				
<3>	M_DP_NA_1	x		x		x										x					
<4>	M_DP_TA_1																				
<5>	M_ST_NA_1																				
<6>	M_ST_TA_1																				
<7>	M_BO_NA_1																				
<8>	M_BO_TA_1																				
<9>	M_ME_NA_1	x		x		x										x					
<10>	M_ME_TA_1																				
<11>	M_ME_NB_1	x		x		x										x					
<12>	M_ME_TB_1																				
<13>	M_ME_NC_1	x		x		x										x					
<14>	M_ME_TC_1																				
<15>	M_IT_NA_1	x		x		x											x				
<16>	M_IT_TA_1																				
<17>	M_EP_TA_1																				
<18>	M_EP_TB_1																				
<19>	M_EP_TC_1																				
<20>	M_PS_NA_1																				
<21>	M_ME_ND_1																				
<30>	M_SP_TB_1	x		x		x										x					
<31>	M_DP_TB_1	x		x		x										x					
<32>	M_ST_TB_1																				
<33>	M_BO_TB_1																				
<34>	M_ME_TD_1	x		x		x										x					
<35>	M_ME_TE_1	x		x		x										x					
<36>	M_ME_TF_1	x		x		x										x					
<37>	M_IT_TB_1	x		x		x											x				
<38>	M_EP_TD_1																				
<39>	M_EP_TE_1																				
<40>	M_EP_TF_1																				
<45>	C_SC_NA_1						x	x	x	x	x						x	x	x		
<46>	C_DC_NA_1						x	x	x	x	x						x	x	x		
<47>	C_RC_NA_1																				
<48>	C_SE_NA_1																				
<49>	C_SE_NB_1																				
<50>	C_SE_NC_1																				
<51>	C_BO_NA_1																				
<58>	C_SC_TA_1																				
<59>	C_DC_TA_1																				
<60>	C_RC_TA_1																				
<61>	C_SE_TA_1																				
<62>	C_SE_TB_1																				
<63>	C_SE_TC_1																				
<64>	C_BO_TA_1																				
<70>	M_EI_NA_1*				x										x					x	x
<100>	C_IC_NA_1							x	x		x							x	x		

Type identification		Cause of transmission																		
		1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47
<101>	C_CI_NA_1					x	x			x							x	x		
<102>	C_RD_NA_1					x											x	x	x	
<103>	C_CS_NA_1																x	x		
<104>	C_TS_NA_1																			
<105>	C_RP_NA_1																			
<106>	C_CD_NA_1																			
<107>	C_TS_TA_1																			
<110>	P_ME_NA_1																			
<111>	P_ME_NB_1						x													
<112>	P_ME_NC_1						x													
<113>	P_AC_NA_1																			
<120>	F_FR_NA_1																			
<121>	F_SR_NA_1																			
<122>	F_SC_NA_1																			
<123>	F_LS_NA_1																			
<124>	F_AF_NA_1																			
<125>	F_SG_NA_1																			
<126>	F_DR_TA_1*																			
<127>	F_SC_NB_1*																			
* Blank or x only																				

## A.2.6 Basic application functions

### Station initialization

(station-specific parameter, mark "x" if function is used)

- Remote initialization

### Cyclic data transmission

(station-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- Cyclic data transmission

### Read procedure

(station-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- Read procedure

### Spontaneous transmission

(station-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- Spontaneous transmission

## Double transmission of information objects with cause of transmission spontaneous

(station-specific parameter, mark each information type "x" where both a Type ID without time and corresponding Type ID with time are issued in response to a single spontaneous change of a monitored object)

The following type identifications may be transmitted in succession caused by a single status change of an information object. The particular information object addresses for which double transmission is enabled are defined in a project-specific list.

- Single-point information M\_SP\_NA\_1, M\_SP\_TA\_1, M\_SP\_TB\_1 ~~and M\_PS\_NA\_1~~
- Double-point information M\_DP\_NA\_1, M\_DP\_TA\_1 and M\_DP\_TB\_1
- Step position information M\_ST\_NA\_1, M\_ST\_TA\_1 and M\_ST\_TB\_1
- Bitstring of 32 bit M\_BO\_NA\_1, M\_BO\_TA\_1 and M\_BO\_TB\_1 (if defined for a specific project, see 7.2.1.1)
- Measured value, normalized value M\_ME\_NA\_1, M\_ME\_TA\_1, ~~M\_ME\_ND\_1~~ and M\_ME\_TD\_1
- Measured value, scaled value M\_ME\_NB\_1, M\_ME\_TB\_1 and M\_ME\_TE\_1
- Measured value, short floating point number M\_ME\_NC\_1, M\_ME\_TC\_1 ~~and M\_ME\_TF\_1~~

## Station interrogation

(station-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- |   |  |  |
|---|--|--|
| <input checked="" type="checkbox"/> global  |  |  |
| <input checked="" type="checkbox"/> group 1 | <input checked="" type="checkbox"/> group 7  | <input checked="" type="checkbox"/> group 13 |
| <input checked="" type="checkbox"/> group 2 | <input checked="" type="checkbox"/> group 8  | <input checked="" type="checkbox"/> group 14 |
| <input checked="" type="checkbox"/> group 3 | <input checked="" type="checkbox"/> group 9  | <input checked="" type="checkbox"/> group 15 |
| <input checked="" type="checkbox"/> group 4 | <input checked="" type="checkbox"/> group 10 | <input type="checkbox"/> group 16            |
| <input checked="" type="checkbox"/> group 5 | <input checked="" type="checkbox"/> group 11 |  |
| <input checked="" type="checkbox"/> group 6 | <input checked="" type="checkbox"/> group 12 |  |
- Information object addresses assigned to each group are configurable (see Section 6.3 in this guide)

## Clock synchronization

(station-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- Clock synchronization
- Day of week used
- RES1, GEN (time tag substituted/ not substituted) used
- SU-bit (summertime) used

optional, see 7.6

## Command transmission

(object-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- Direct command transmission
- Direct set point command transmission
- Select and execute command
- Select and execute set point command
- C\_SE ACTTERM used
- No additional definition

- Short-pulse duration (duration determined by a system parameter in the controlled station)
- Long-pulse duration (duration determined by a system parameter in the controlled station)
- Persistent output
- Supervision of maximum delay in command direction of commands and set point commands
- 30 s Maximum allowable delay of commands and set point commands

### Transmission of integrated totals

(station- or object-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- Mode A: local freeze with spontaneous transmission
- Mode B: local freeze with counter interrogation
- Mode C: freeze and transmit by counter interrogation commands
- Mode D: freeze by counter-interrogation command, frozen values reported spontaneously
- Counter read
- Counter freeze without reset
- Counter freeze with reset
- Counter reset
- General request counter
- Request counter group 1
- Request counter group 2
- Request counter group 3
- Request counter group 4

### Parameter loading

(object-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- Threshold value
- Smoothing factor
- Low limit for transmission of measured value
- High limit for transmission of measured

### Parameter activation

(object-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- Act/deact of persistent cyclic or periodic transmission of the addressed object

### Test procedure

(station-specific parameter, mark "x" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions).

- Test procedure

## File transfer

(station-specific parameter, mark "x" if function is used).

### File transfer in monitor direction

- Transparent file
- Transmission of disturbance data of protection equipment
- Transmission of sequences of events
- Transmission of sequences of recorded analogue values

### File transfer in control direction

- Transparent file

## Background scan

(station-specific parameter, mark "x" if function is only used in the standard direction, "**R**" if only used in the reverse direction, and "**B**" if used in both directions).

- Background scan

## Acquisition of transmission delay

(station-specific parameter, mark "x" if function is only used in the standard direction, "**R**" if only used in the reverse direction, and "**B**" if used in both directions).

- Acquisition of transmission delay

## Definition of time outs

Parameter	Default value	Remarks	Selected value
$t_0$	30 s	Time-out of connection establishment	Not used
$t_1$	15 s	Time-out of send or test APDUs	Not used
$t_2$	10 s	Time-out for acknowledges in case of no data messages $t_2 < t_1$	Not used
$t_3$	20 s	Time-out for sending test frames in case of a long idle state	5 min

Maximum range for timeouts  $t_0$  to  $t_2$ : 1 s to 255 s, accuracy 1 s.

Recommended range for timeout  $t_3$ : 1 s to 48 h, resolution 1 s.

Long timeouts for  $t_3$  may be needed in special cases where satellite links or dialup connections are used (for instance to establish connection and collect values only once per day or week).

## Maximum number of outstanding I format APDUs $k$ and latest acknowledge APDUs ( $w$ )

Parameter	Default value	Remarks	Selected value
$k$	12 APDUs	Maximum difference receive sequence number to send state variable	Configurable from 1 to 32. Can be set to 0 for unlimited number of ASDUs.
$w$	8 APDUs	Latest acknowledge after receiving $w$ I format APDUs	Not used

Maximum range of values  $k$ : 1 to 32767 ( $2^{15}-1$ ) APDUs, accuracy 1 APDU

Maximum range of values  $w$ : 1 to 32767 APDUs, accuracy 1 APDU (Recommendation:  $w$  should not exceed two-thirds of  $k$ ).

## Port number

Parameter	Value	Remarks
Portnumber	2404	In all cases

## Redundant connections

Number N of redundancy group connections used

## RFC 2200 suite

RFC 2200 is an official Internet Standard, which describes the state of standardization of protocols used in the Internet as determined by the Internet Architecture Board (IAB). It offers a broad spectrum of actual standards used in the Internet. The suitable selection of documents from RFC 2200 defined in this standard for given projects has to be chosen by the user of this standard.

- Ethernet 802.3
- Serial X.21 interface
- Other selection from RFC 2200:

### List of valid documents from RFC 2200

1. .....
2. .....
3. .....
4. .....
5. .....
6. .....